

RDH Series Centrifugal Blower

Professional HVAC Fan & Motors Manufacturer



Type Code

RDH 355 - R

Type R L (Basic model)
Type K (Enhanced model)
Type E (Heavy duty model)
Type C (Handling model)
Type Z (Heavy duty)

Diameter of Impeller

RDH Series

RDH Series Centrifugal Blower


1.Product Features

(1) Rotation

RDH Series ventilator can be divided into two direction of rotations, left-hand rotation (LG) and right-hand rotation (RD); Viewing from end of motor outlet line if the impeller rotates clockwise, it is called right hand ventilator; If the impeller rotates anti-clockwise, it is called left hand ventilator. The pulley can adjust its direction, left or right, therefore there is no limitation in directionality.

(2) Direction of Air Outlet

According to Fig 1. RDH Series ventilator can be made in four air-outlet directions: 0°, 90°, 180°, and 270°.

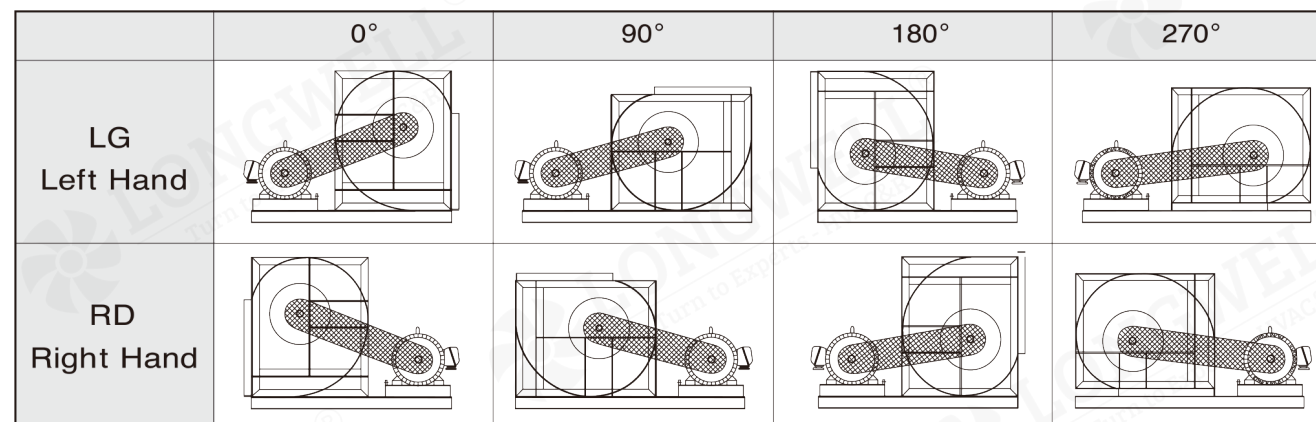

(Fig 1)

(3) Type of Structure

There are three types of RDH ventilators, type R, type K and type Z. The type R represents the basic model, while the type K is designed for use at the higher power levels, and the type Z at the heavy duty levels.

2.Construction of Product

The major components of the RDH Series ventilators include the scroll, impeller, frame, bearings, shaft, and outlet flange. (Outlet flange should be indicated when placing order)

(1) Scroll

The scroll is made of hot galvanized steel sheet, and it is designed to provide an aerodynamically efficient flow path. The inlet is formed in one piece. The scroll is fixed to the side plates by "spot welding" or "seam locking".

(2) Impeller

The RDH impeller is made of high grade cold-rolled steel sheet. It is to provide a highly efficient and low noise and specially-designed blades, are welded on the center disc, and painted with polyester coatings. The impellers are dynamic balanced testing balanced before assembly in accordance with national standards.

(3) Frame

The frames of RDH made of angle flat steel to assure sufficient frame rigidity and intensity they are painted with polyester coatings.

(4) Bearings


Out-spherical ball bearings are used RDH Series ventilators. They are high quality with low noise ventilator. The bearing are supplied with lubrication fittings, they are pre-lubricated, sealed and self centering, For type L/R/K ventilators, self-aligning ball bearings are used, for type Z ventilators, heavy duty bearings housings are used.

(5) Shaft

The shafts are made of 40 Cr or C45 carbon steel bars. The shafts are rough machined and then stress relieved before final machining. The shaft diameters are machined to very accurate tolerance levels and they are fully checked to assure precision fits. They are coated after assembly in order to provide corrosion resistance.

(6) Outlet Flange

The outlet flange is made of galvanized steel sheet. The connections of the flange to the scroll is made using a TOX non-welding process. This maintains a good flange appearance while also providing sufficient strength and rigidity. The outlet flange dimensions are provided in Figure 2.

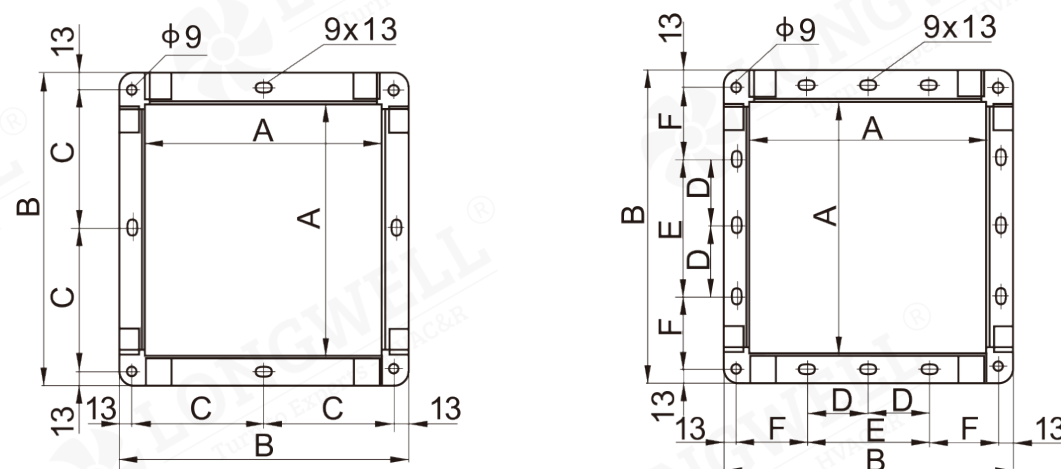

Type	200	225	250	280	315	355	400	450	500	560	630	710	800	900	1000
A	256	288	322	361	404	453	507	569	638	715	801	898	1007	1130	1267
B	296	328	362	417	460	509	563	625	694	771	857	954	1063	1186	1323
C	138	154	171	195.5	217	241.5	-	-	-	-	-	-	-	-	-
D	-	-	-	-	-	-	-	-	-	-	-	200	250	300	350
E	-	-	-	-	-	-	200	200	250	250	300	400	500	600	700
F	-	-	-	-	-	-	168.5	199.5	209	247.5	265.5	264	268.5	280	298.5

(Fig 2)

3.Performance of Ventilator

1.The ventilator performance in this catalogue denotes the performance in standard conditions.

It denotes air inlet conditions of ventilator as follows:

Air inlet pressure Pa =101.325KPa Air temperature t = 20°C

Inlet gas density ρ= 1.2Kg/ms

If the practical air inlet conditions of customer or the speed of the operating ventilator changes, the conversion can be carried out according to the following expression:

$$\frac{Q_0^*}{Q_0} = \frac{n^*}{n}$$

$$\frac{P_0^*}{P_0} = \frac{n^{*2}}{n^2} \cdot \frac{\rho^*}{\rho} \quad \frac{P_0^*}{P_0} = \frac{n^{*2}}{n^2} \cdot \frac{Pa^*}{Pa} \cdot \frac{273+t}{273+t^*}$$

$$\frac{N_{in_0}^*}{N_{in_0}} = \frac{n^{*3}}{n^3} \cdot \frac{\rho^*}{\rho} \quad \frac{N_{in_0}^*}{N_{in_0}} = \frac{n^{*3}}{n^3} \cdot \frac{Pa^*}{Pa} \cdot \frac{273+t}{273+t^*}$$

where:

- Volume Q_0 (m³/h),total pressure P_0 (Pa),speed n (r/min) can be obtained from Performance chart.
 - Asterisk (*) on the upper right corner denotes the performance parameter needed by the customers in practical gas inlet conditions.
 - The difference in relative humidity is omitted from the abovementioned formulas.
- 2.The power (N_{in_0}) on the performance chart the internal power of the ventilator.
- Shaft power of ventilator: $N_s = N_{in_0}/\eta_m$

where: N_s -Shaft power of ventilator η_m -Mechanical efficiency of ventilator

The value of mechanical efficiency of ventilator can be obtained from Table 1.

Way of Ventilator Driving	η_m
Electric Motor Directly Driven	1
Coupling Directly Driven	0.98
V-belt Driven	0.95

(Table1)

The rated power of the drive motor equals the total required shaft input power multiplied by the safety factor:

$N = N_s \cdot K$ where: N =rated power of drive motor K = required safety factor

The required safety factor is provided in Table 2.

Power of Electric Motor(KW)	Value K
≤2.2KW	1.2
≤7.5KW	1.15
≥11KW	1.1

(Table2)

3.Noise:The noise levels shown on each performance chart, L_{wIA} ,refer to the overall sound power "A-Weighted" levels.The computed sound power levels were converted into A-Weighted levels using adjustments to the octave band spectrum as follows:

Center Frequency Hz	63	125	250	500	1000	2000	4000	8000
A-Weighted Adjustment dB(A)	-25.5	-12.5	-8.5	-3	0	+1	+1	-1

(Table3)

The overall sound pressure levels, L_{pIA} ,can be computed from the overall sound power levels as follows:

Free Field Conditions: $L_{pIA} = L_{wIA} - (20 \log_{10} d) - 11$

Room Conditions: $L_{pIA} = L_{wIA} - (20 \log_{10} d) - 7$

Where: d = distance from fan in meters


4.Comparing the performance of the twin ventilator of Category L2, Category R2 and Category K2 with the performance of Category L, Category R and K in the chart in the same condition of pressure, the twin ventilators' performance is as the following.

Volume x 2 Speed x 1.05 Inner Power x 2.15 Noise +3

Performance of twin ventilators are not licensed by AMCA International.

4.V-Belt Drive Installation

- 1.Remove the protective coating from the ends of the fan shaft and assure that the shaft ends are free of nicks and burrs.
- 2.Check fan and motor shafts for parallel and angular alignment.
- 3.The center distance must be controlled as $0.7(d_1+d_2)<2(d_1+d_2)$;the belt speed of forward fan should be more than 10m/s,but less than 15m/s,($10<v<15\text{m/s}$);the belt speed of backward fan should be more than 25m/s,but less than 35m/s,($25<v<35\text{m/s}$).
- 4.Slide sheaves on to the shafts-do not drive the sheaves on to the shafts as this may result in bearing damage.
- 5.Align fan and motor sheaves with a straight-edge or string,and tighten.
- 6.Place belts over the sheaves with carefull,otherwise the belts will be damaged.
- 7.Adjust the belt tension until the belts appear snug.Run the unit for a few minutes and allow the belts to set properly.
- 8.Switch off the fan,adjust the belt tension by moving the motor base.When in operation,the tight side of the belts should be in a straight line from sheave to sheave and there should be a slight bow on the slack side.

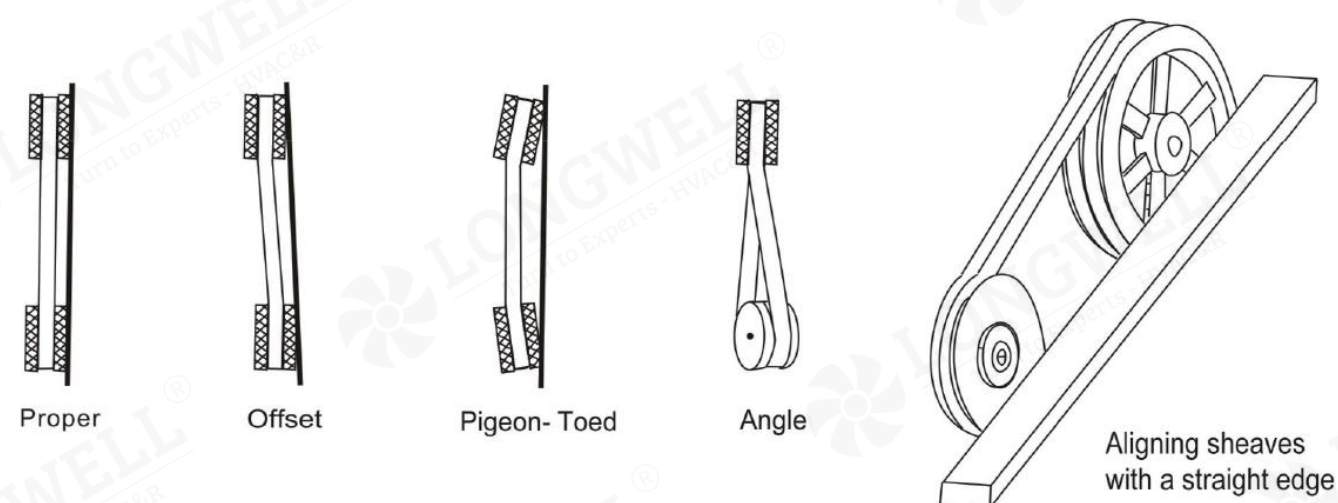

5.Belt Tenstion


A proper level of belt tension is required in order to obtain a satisfactory belt life. If the belt tension level is too high,then excessive loads will be imposed on the belts and the bearings, and this will reduce the lives of both of these components. If the belt tension level is too low.then the belt will slip.Belt slippage generates a large amount or heat,and this heat will drastically reduce the life of a belt.

Belt-tensioning gauges can be used to determine whether the belts are tensioned properly.A chart is normally supplied with the gauge which indicates the ranges of forces required to deflect the belts by a given amount to obtain the proper belt tension level.The required forces are based upon the center distance of the sheaves and the belt cross-section. the belts are properly tensioned when the forces required to deflect the belt are within the specified range. see Fig 4 and Table 3.

If a bet-tensioning gauge is not available,then the belt should be tightened just enough so that the belt does not squeal when the ventlator is started. A very short period of noise during the starting of a ventiator is allowable,but a squeal lasting several seconds or longer ie not acceptable. After tensioning the belts and before starting the ventilator,check to make sure that the sheaves are properly aligned.

Realign the sheaves if necessary.note that new belts may stretch a little during inital use,so the belt tension level should be checked after a few days of operation.

Belt tension indicator applied to mid centre distance.

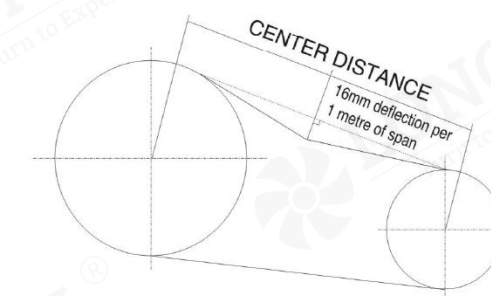

(Fig 4)

Belt Section	Force required to deflect belt 16mm per metre of span		
	Smiall Pulle/Diamter(mm)	Newton(N)	Kilogram Force (Kgf)
SPZ	56-95	13-20	1.3-2.0
	100-140	20-25	2.0-2.5
SPA	80-132	25-35	2.5-3.6
	140-200	35-45	3.6-4.6
SPB	112-224	45-65	4.6-6.6
	236-315	65-85	6.6-8.7
SPC	224-335	85-115	8.7-11.7
	375-560	115-150	11.7-15.3
A	80-140	10-15	1.1-1.5
B	125-200	20-30	2.0-3.1

(Table3)

6.Bearing Lubrication


The ventilator bearings are filled with lubricant when they come from the factory, so the bearings do not require any additional grease to be supplied before starting the ventilator.

The ventilator that are equipped with pillow block bearings are provided with lubrication fittings, and these fittings allow for additional lubrication to be supplied to the bearings at regular intervals. The allowable period of time between lubrication of these bearings depends upon the operating speeds and temperatures of the bearing as well as on the type of grease used. The best way to determine the required frequency of lubrication is to inspect the condition of the grease that is discharged from the seals when new grease is added. If the discharged grease looks similar to the new grease, then a longer period of time between lubrications is possible. If the discharged grease is much darker than the new grease, then this indicates that the grease is being oxidized and more frequent lubrications of the bearings are required.

7.Instructions


- (1) During ordering it is necessary to state the type of ventilator, speed, air volume, air pressure, direction of air outlet, rotating direction, type of electric motor and its specifications.
- (2) Prior to installation, the ventilator should be carefully inspected. Special care should be taken in checking the shaft, impeller and bearings. If there is an indication of any damage, then the damaged parts should be repaired or replaced before the ventilator is installed or operated.
- (3) The inside of the scroll and casing need to be checked to make sure that there are no foreign objects contained therein, such as tools or loose parts.
- (4) The rotational directions of the motor and impeller should be checked to assure that they are consistent with each other.
- (5) A flexible connector should be used between the ventilator outlet flange and its mating pipe. The bolts used to fasten the outlet flange to the pipe should not be over-tightened.
- (6) Following the installation, the impeller should be turned by hand or with the use of a wrench to make sure that it turns freely. Once this is verified, the ventilator can be operated normally.
- (7) The rated motor power as calculated herein is not sufficient to drive the ventilator with an unrestricted discharge flow path. Operating the ventilator with an unrestricted discharge flow path will result in flow rates that exceed the ventilator flow rate capabilities, and such operation will quickly burn out the motor. So care must be taken in operating the ventilators to make sure that the maximum rated flows, as provided on the performance charts in this brochure, are not exceeded.
- (8) This fan is restricted for use in areas where air substances are noncorrosive and non-toxic, non-alkaline or where dust particles $< 150\text{mg/m}^3$, $-20^\circ\text{C} < \text{temperature} < 85^\circ\text{C}$. If special conditions during transportation, load and unload, it is strictly prohibited to shock the ventilators.

8.Example of Cruve Reading

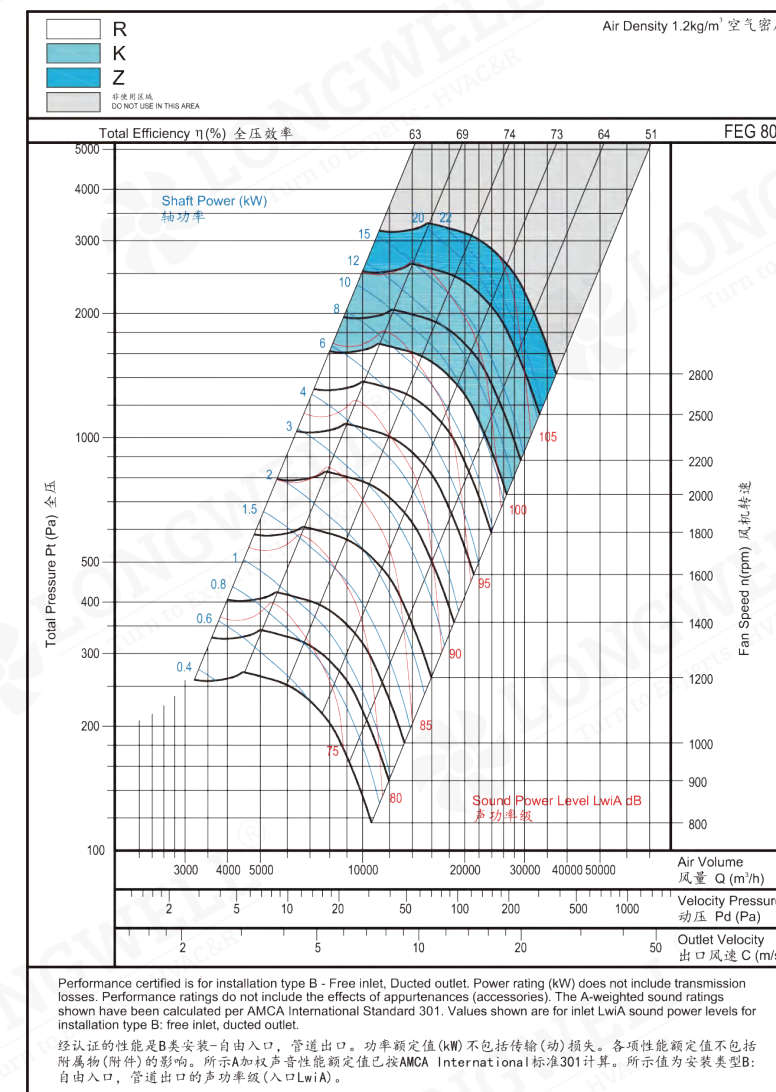

Volume	V=17600m³/h
Total Pressure	Pt=2000Pa
Dynamic Pressure	Pd=82Pa
Outlet Velocity	C=11.7 m/s
Speed	n=2200 r/min
Impeller Tip Speed	U ₂ =59 m/s
Inner Power	N _{ino} =12.8 kW
Sound Power Level	L _{wi} A=100dB(A)
Total Pressure Efficiency	η=76%

RDH - R

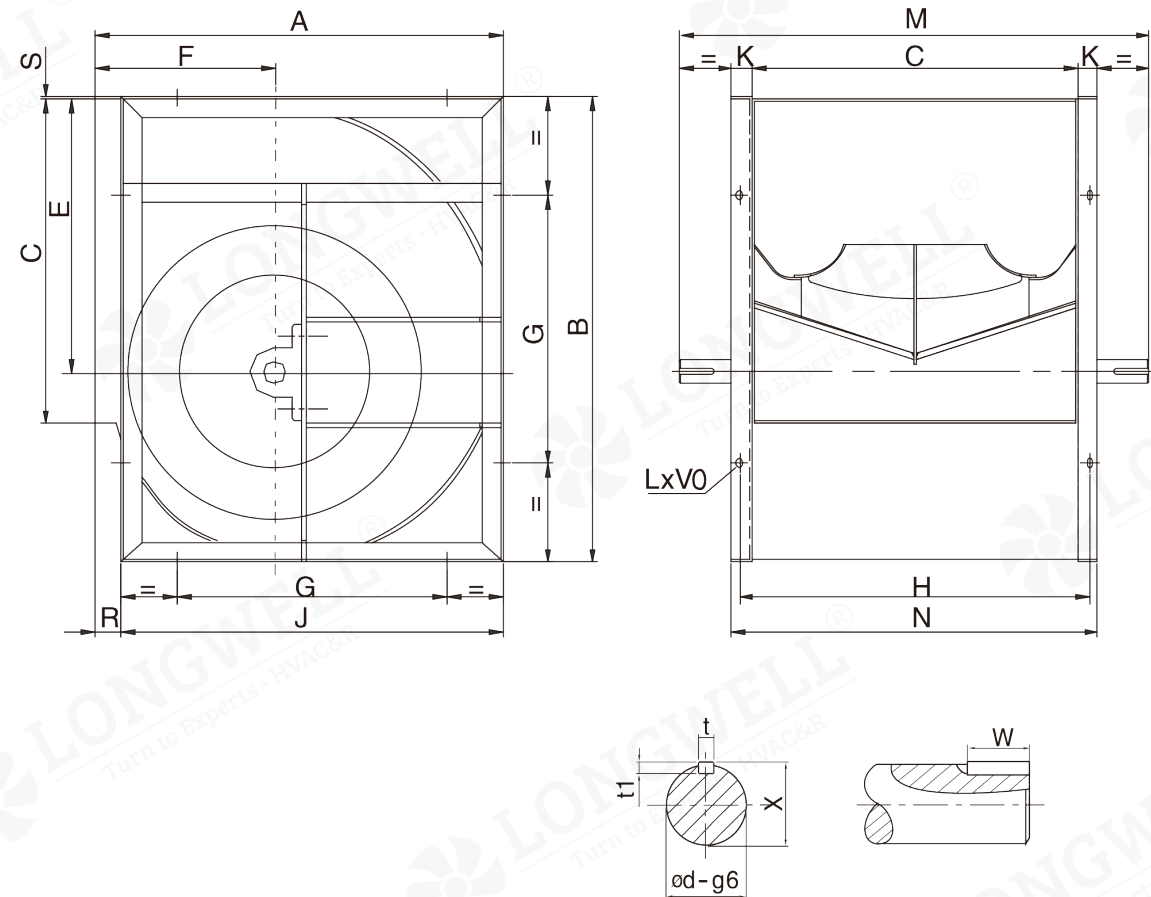


Technical Specifications

Model	A	B	C	E	F	G	H	J	K	M	N	R	S	t	t1	W	X	Φd	L×V
RDH 280-R	466	518	361	302	215	280	391	432	30	575	421	34	5	8	7	50	28	25	13×18
RDH 315-R	518	578	404	340	236	280	434	480	30	640	464	38	3	8	7	60	28	25	13×18
RDH 355-R	578	655	453	383	261	355	493	548	40	700	533	30	6	8	7	60	33	30	13×18
RDH 400-R	651	736	507	431.5	290	355	547	613	40	760	587	38	4.5	8	7	60	33	30	13×18
RDH 450-R	726	827	569	486	322	530	609	681	40	845	649	45	5	10	8	70	38	35	13×18
RDH 500-R	800	918	638	538	352	530	678	750	40	915	718	50	5	10	8	70	38	35	13×18
RDH 560-R	893	1030	715	602	390	530	765	845	50	1000	815	48	8	12	8	70	43	40	13×18
RDH 630-R	999	1157	801	678.5	434	530	851	946	50	1090	901	53	7	14	9	70	48.5	45	13×18
RDH 710-R	1121	1303	898	765	485	630	948	1058	50	1255	998	63	7	14	9	90	53.5	50	17×22

Note: the size unit in the form is mm

RDH - K(Z)

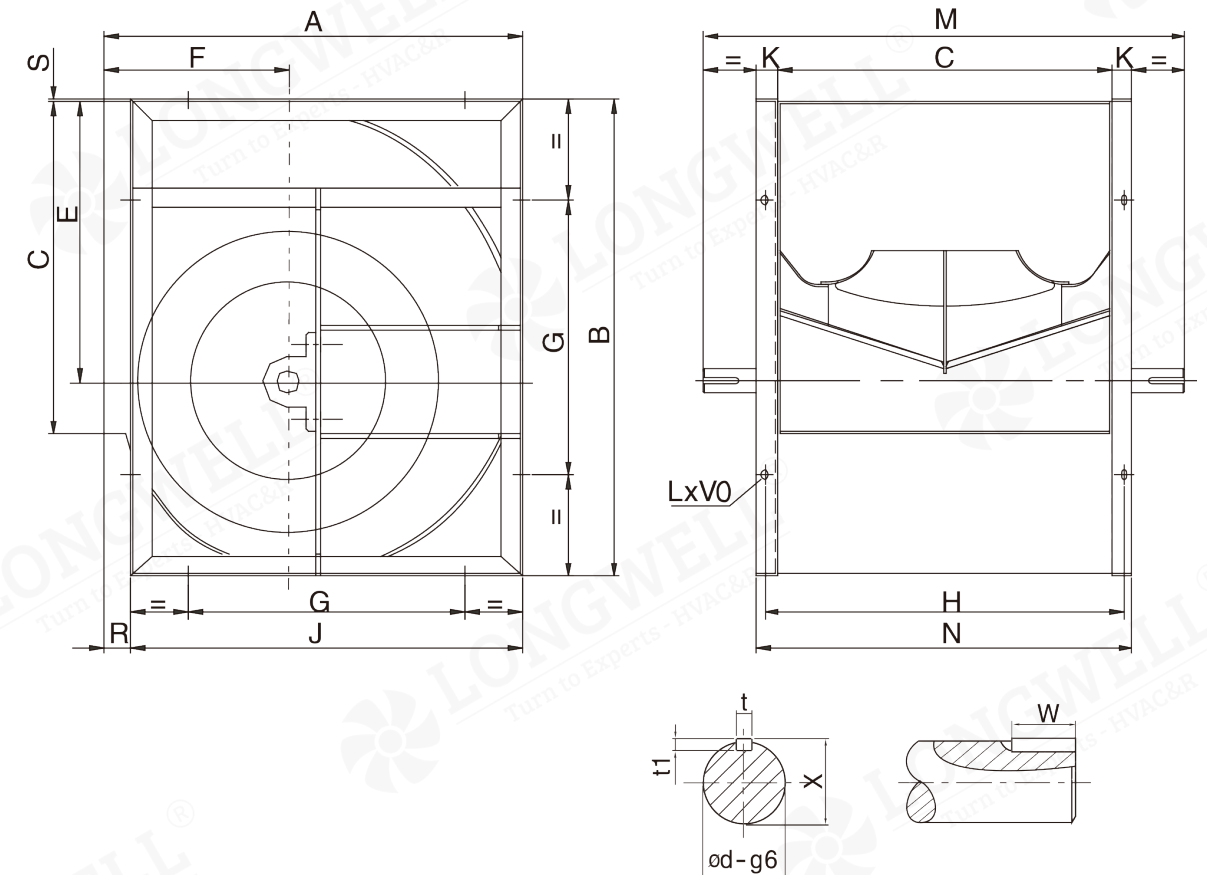


Technical Specifications

Model	A	B	C	E	F	G	H	J	K	M	N	R	S	t	t1	W	X	Φd	L×V
RDH 280-K	466	518	361	302	215	280	391	432	30	600	421	34	5	8	7	60	33	30	13×18
RDH 315-K	518	578	404	340	236	280	434	480	30	665	464	38	3	8	7	70	33	30	13×18
RDH 355-K	578	655	453	383	261	355	493	548	40	725	533	30	6	10	8	70	38	35	13×18
RDH 400-K	651	736	507	431.5	290	355	547	613	40	790	587	38	4.5	10	8	70	38	35	13×18
RDH 450-K	726	827	569	486	322	530	609	681	40	890	649	45	4.5	12	8	90	43	40	13×18
RDH 500-K(Z)	800	918	638	538	352	530	678	750	40	960	718	50	5	12	8	90	43	40	13×18
RDH 560-K(Z)	893	1030	715	603	390	530	765	845	50	1070	815	48	8	14	9	90	53.5	50	13×18
RDH 630-K(Z)	999	1157	801	678.5	434	530	851	946	50	1155	901	53	7	14	9	90	53.5	50	13×18
RDH 710-K(Z)	1121	1303	898	765	485	630	948	1058	50	1290	998	63	7	18	11	90	64	60	17×22
RDH 800-K(Z)	1250	1468	1007	862	535	710	1057	1181	50	1450	1107	69	7	18	11	90	64	60	17×22
RDH 900-K(Z)	1408	1648	1130	971	604	800	1180	1319	60	1570	1250	89	7	18	11	100	69	65	17×22
RDH 1000-K(Z)	1541	1810	1267	1066	657	900	1317	1462	60	1700	1387	79	9	18	11	100	69	65	17×22

Note: the size unit in the form is mm

RDH - R2

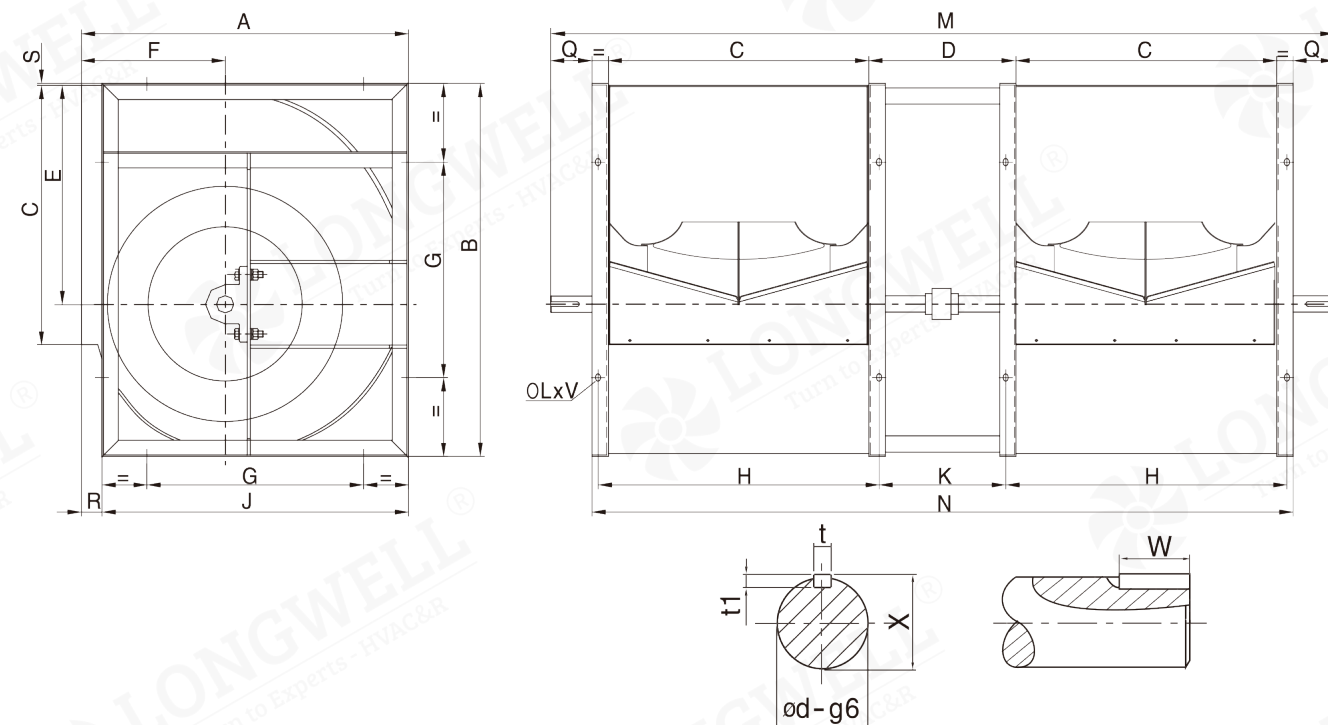


Technical Specifications

Model	A	B	C	D	E	F	G	H	J	K	M	N	Q	R	S	t	t1	W	X	Φd	L×V
RDH 280-R2	466	518	361	280	302	214	280	391	432	250	1216	1060	77	34	5	8	7	50	28	25	13×18
RDH 315-R2	518	578	404	315	340	236	280	434	480	285	1359	1183	88	38	3	8	7	60	28	25	13×18
RDH 355-R2	578	654	453	355	383	260	355	493	548	315	1509	1339	83.5	30	6	8	7	60	33	30	13×18
RDH 400-R2	650	736	507	400	432	290	355	547	612	360	1667	1492	86.5	38	4.5	8	7	60	33	30	13×18
RDH 450-R2	726	827	569	450	486	322	530	609	681	410	1864	1666	98	45	5	10	8	70	38	35	13×18
RDH 500-R2	800	918	638	500	538	352	530	678	750	460	2053	1856	98.5	50	5	10	8	70	38	35	13×18
RDH 560-R2	893	1030	715	560	602	390	530	765	845	510	2275	2090	92.5	48	8	12	8	70	43	40	13×18

Note: the size unit in the form is mm

RDH - K2

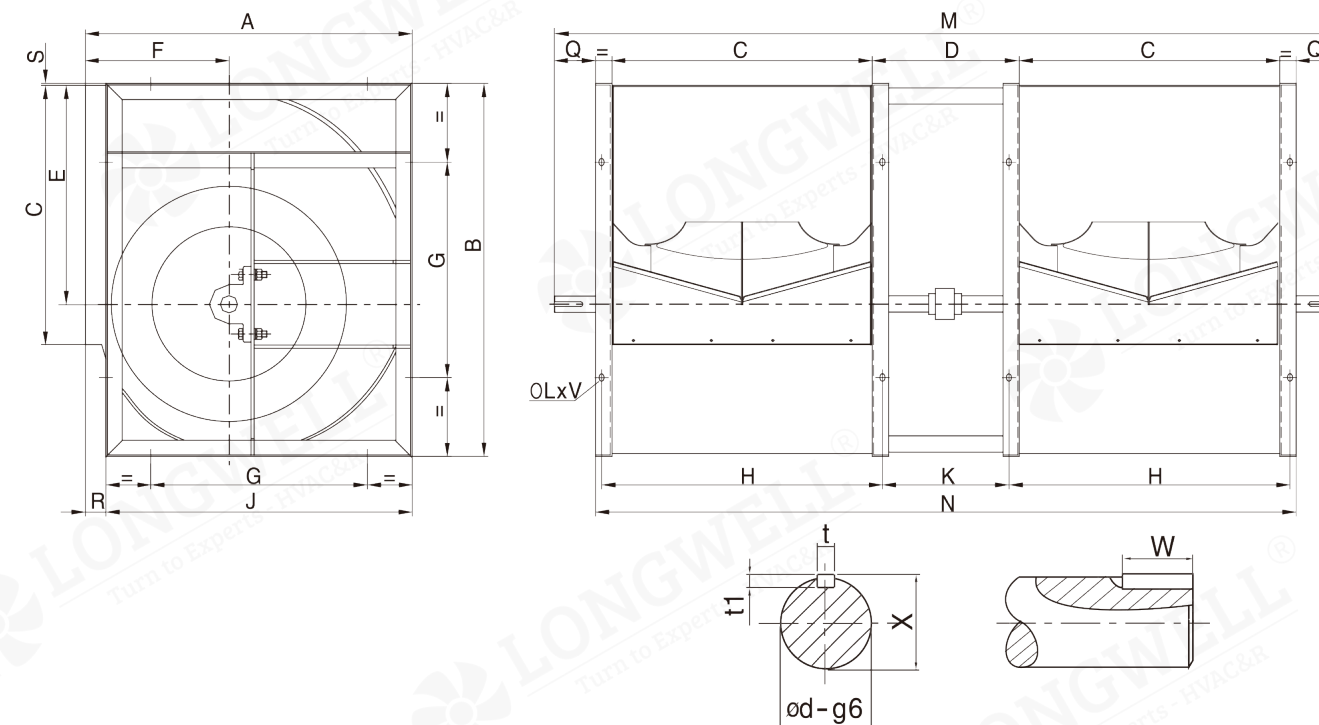


Technical Specifications


Model	A	B	C	D	E	F	G	H	J	K	M	N	Q	R	S	t	t1	W	X	Φd	L×V
RDH 355-K2	578	654	453	355	383	260	355	493	548	315	1533	1339	96	30	6	10	8	70	38	35	13×18
RDH 400-K2	650	736	507	400	432	290	355	547	612	360	1697	1492	99	38	4.5	10	8	70	38	35	13×18
RDH 450-K2	726	827	569	450	486	322	530	609	681	410	1909	1666	120.5	45	5	12	8	90	43	40	13×18
RDH 500-K2	800	918	638	500	538	352	530	678	750	460	2098	1856	121	50	5	12	8	90	43	40	13×18
RDH 560-K2	893	1030	715	560	602	390	530	765	845	510	2345	2090	127.5	48	8	14	9	90	53.5	50	13×18

Note: the size unit in the form is mm


RDH-280

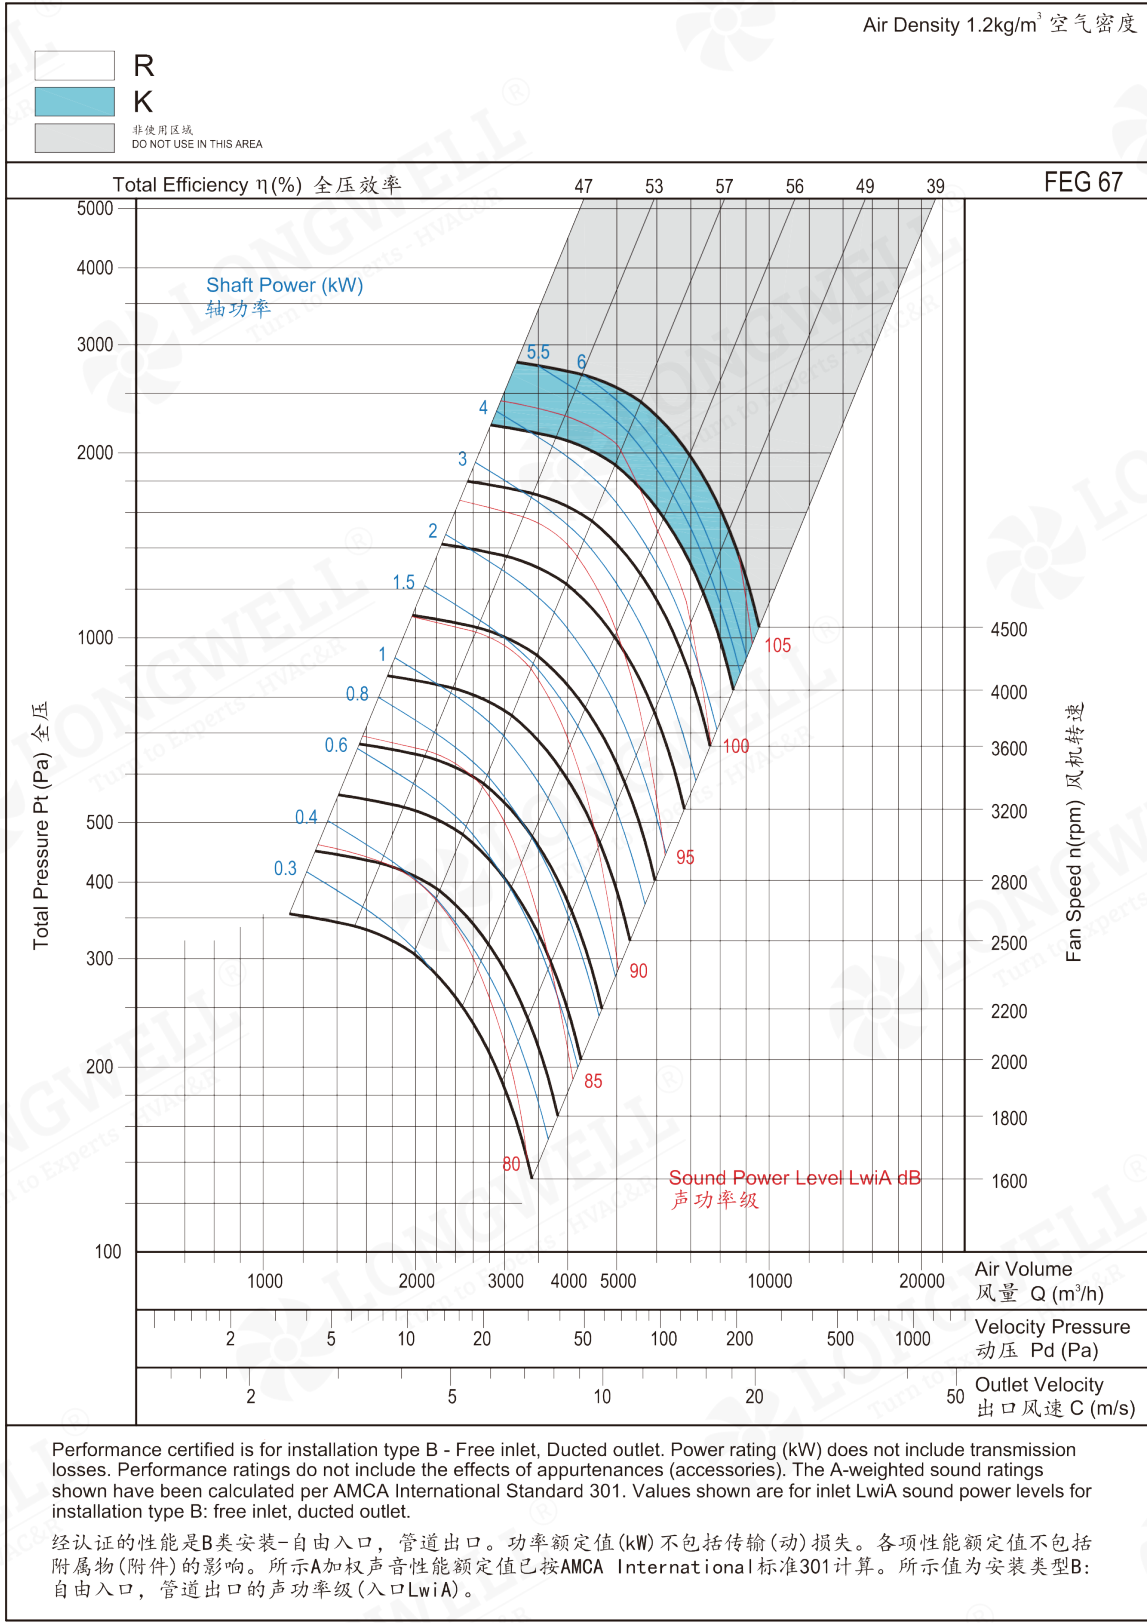


RDH-315

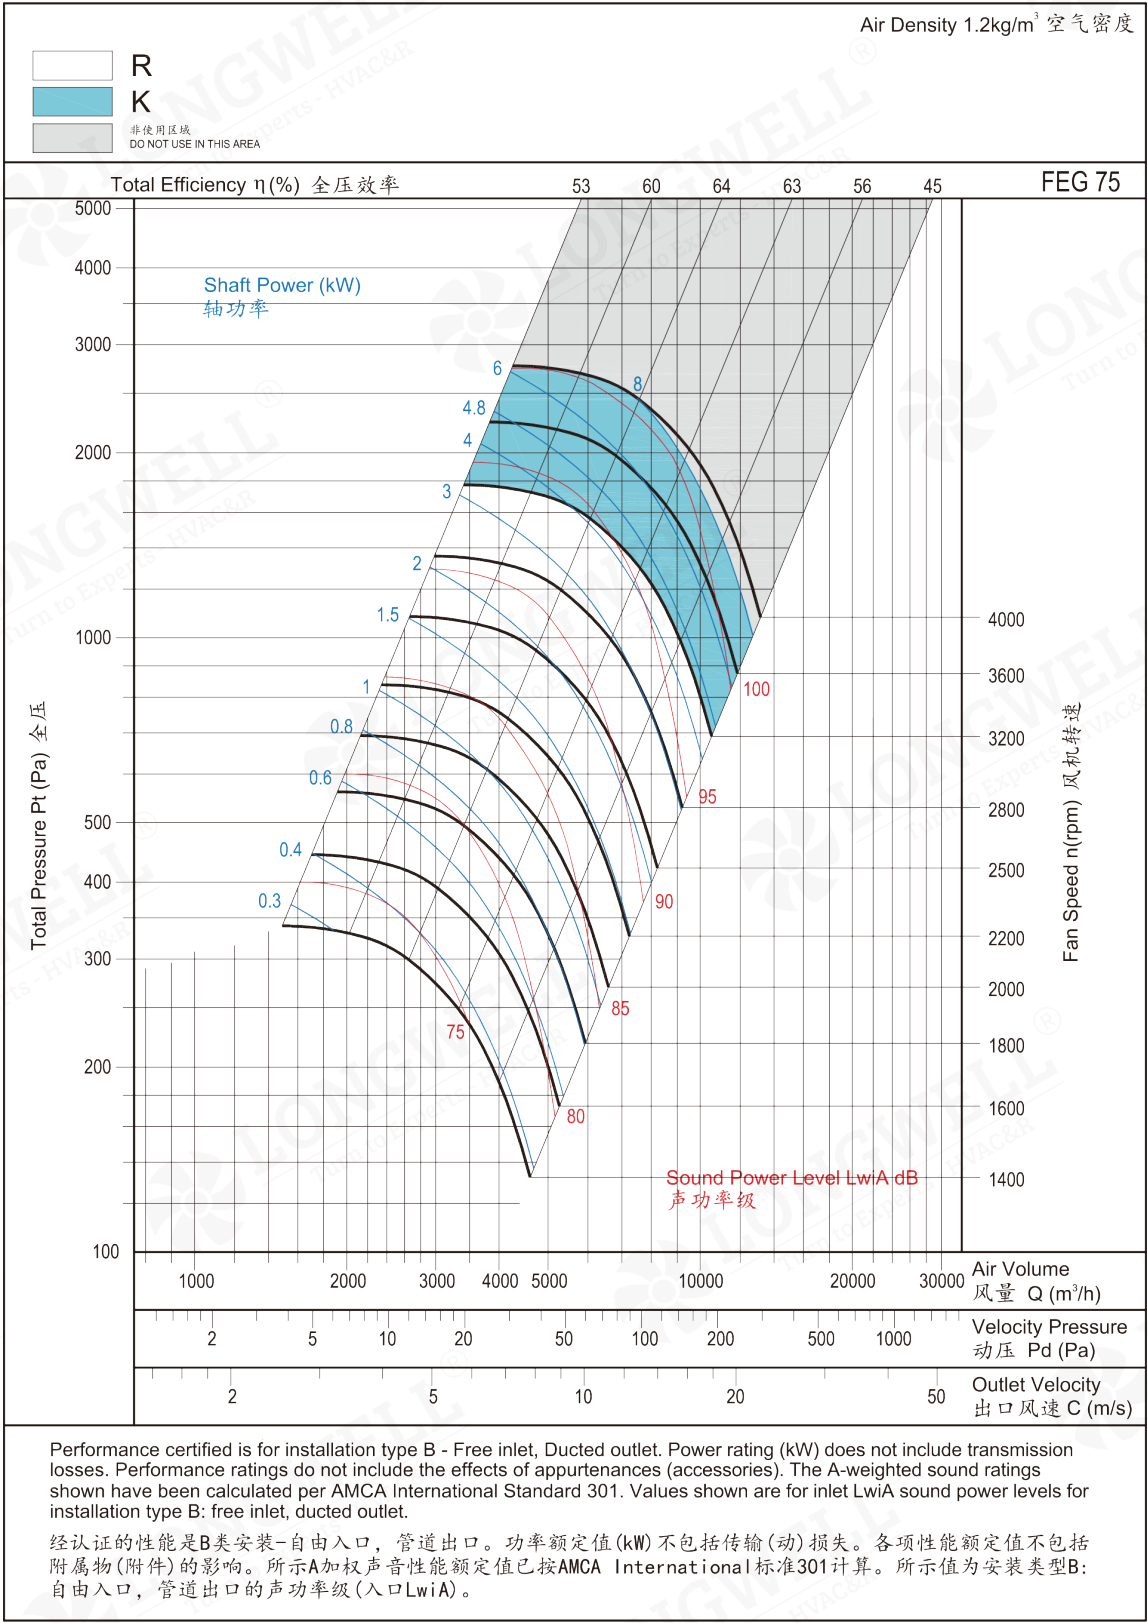


RDH-355

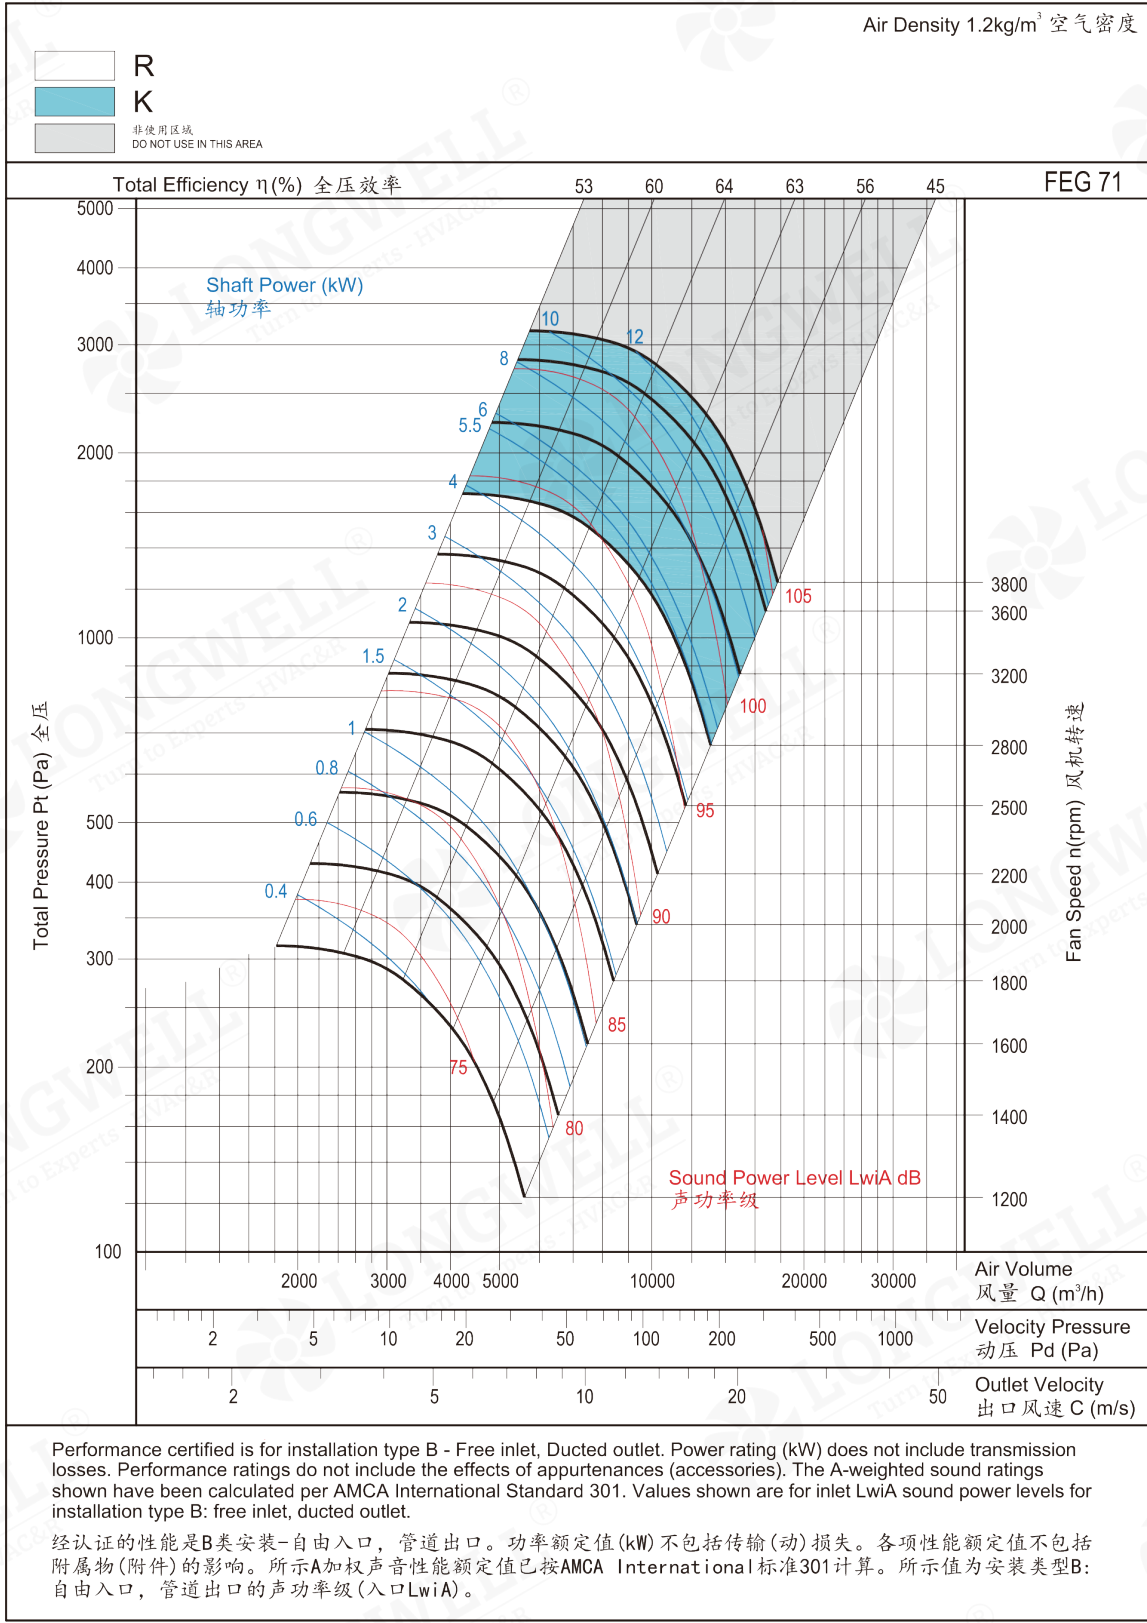


RDH-400

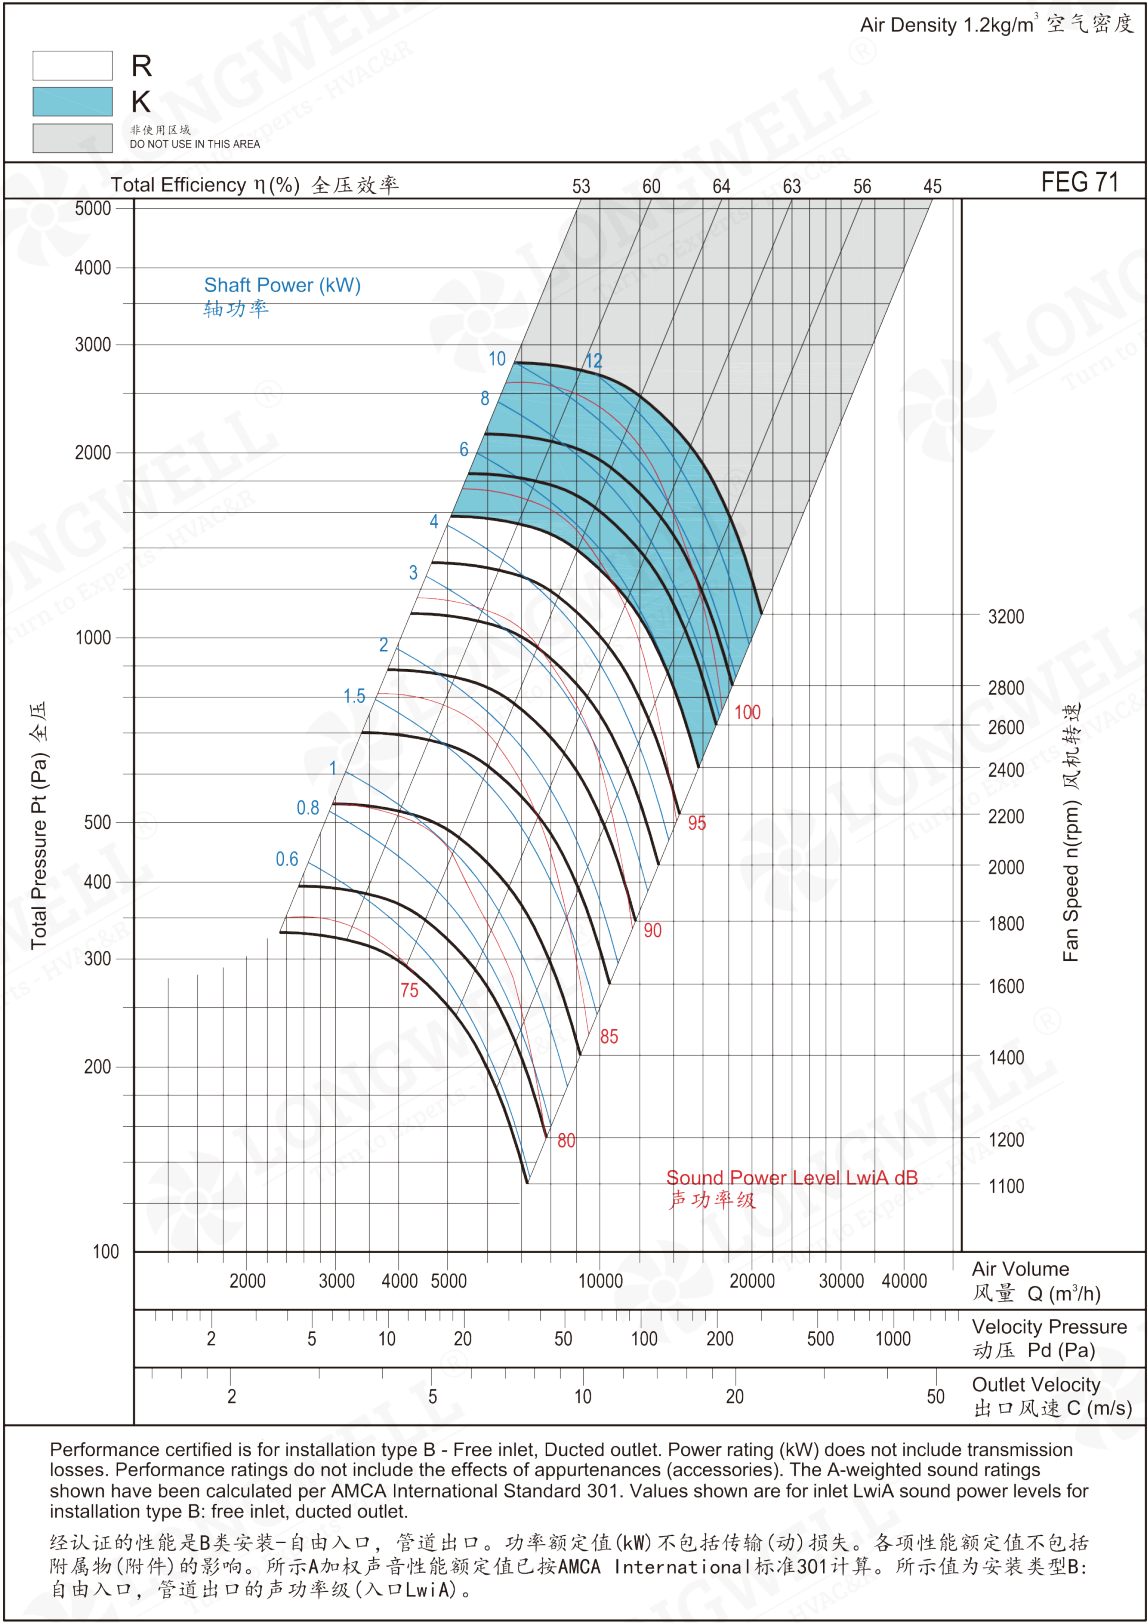


RDH-450

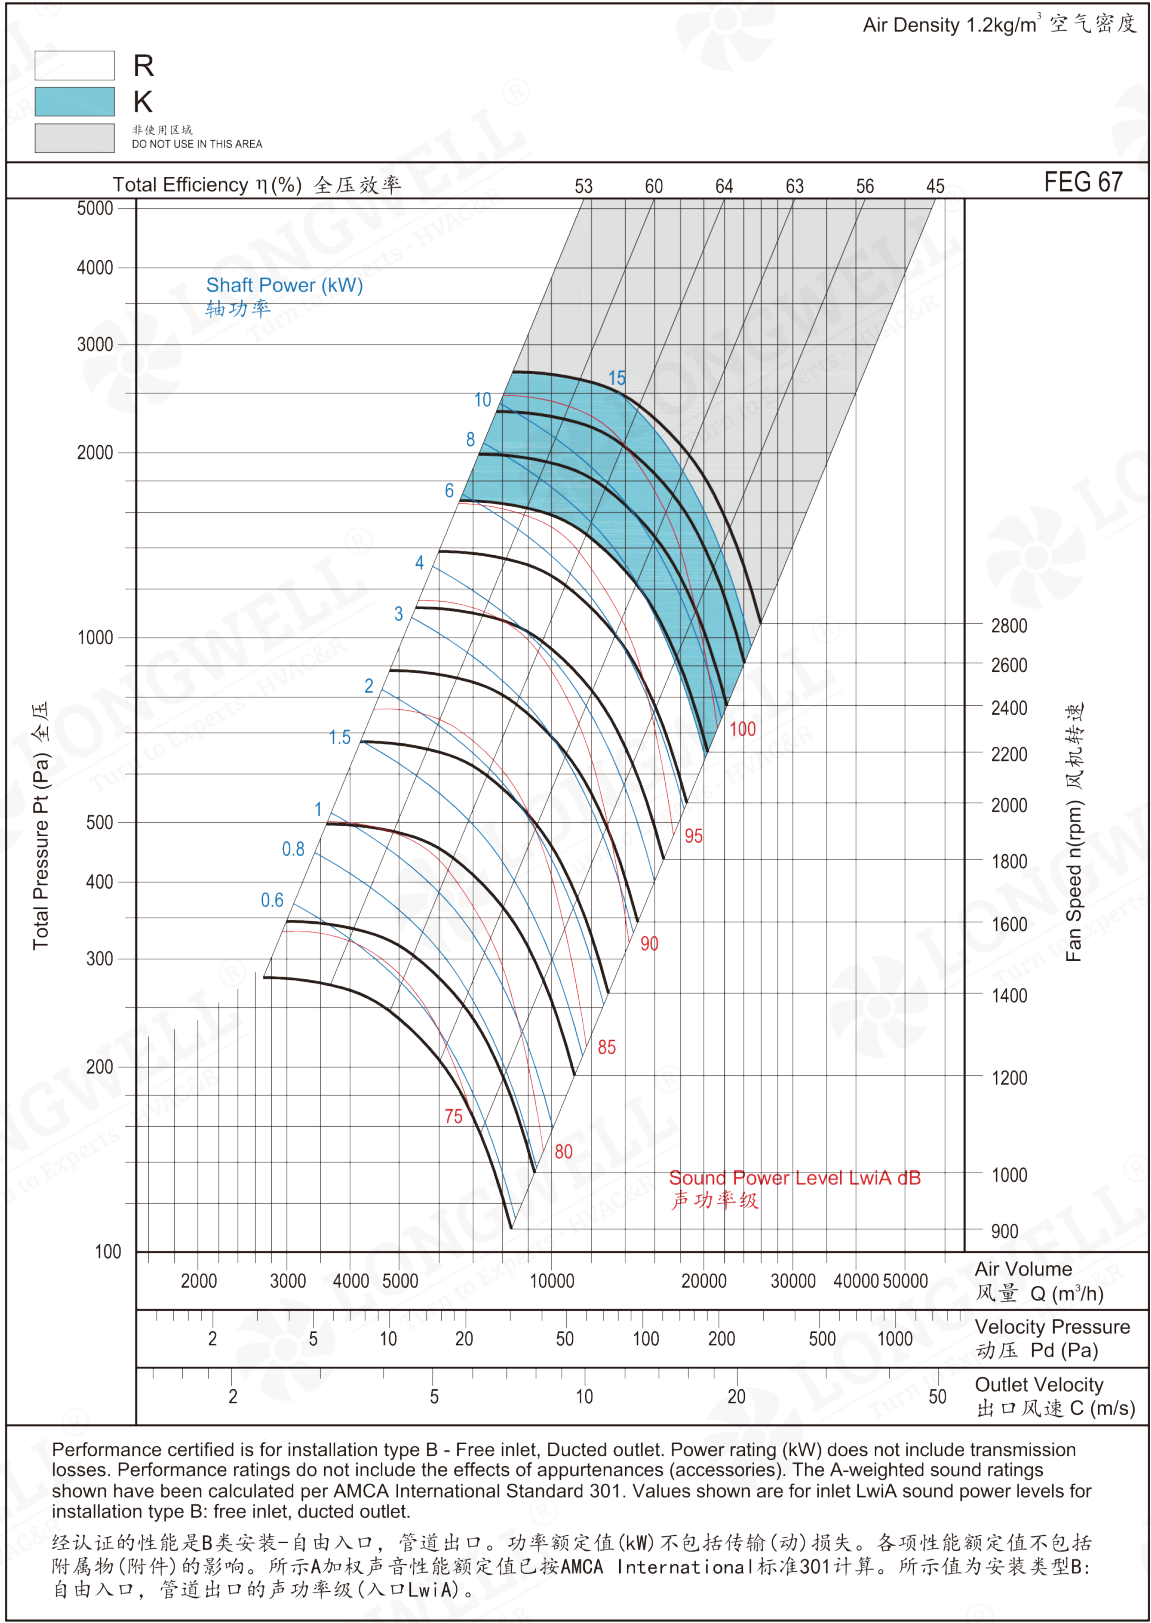


RDH-500

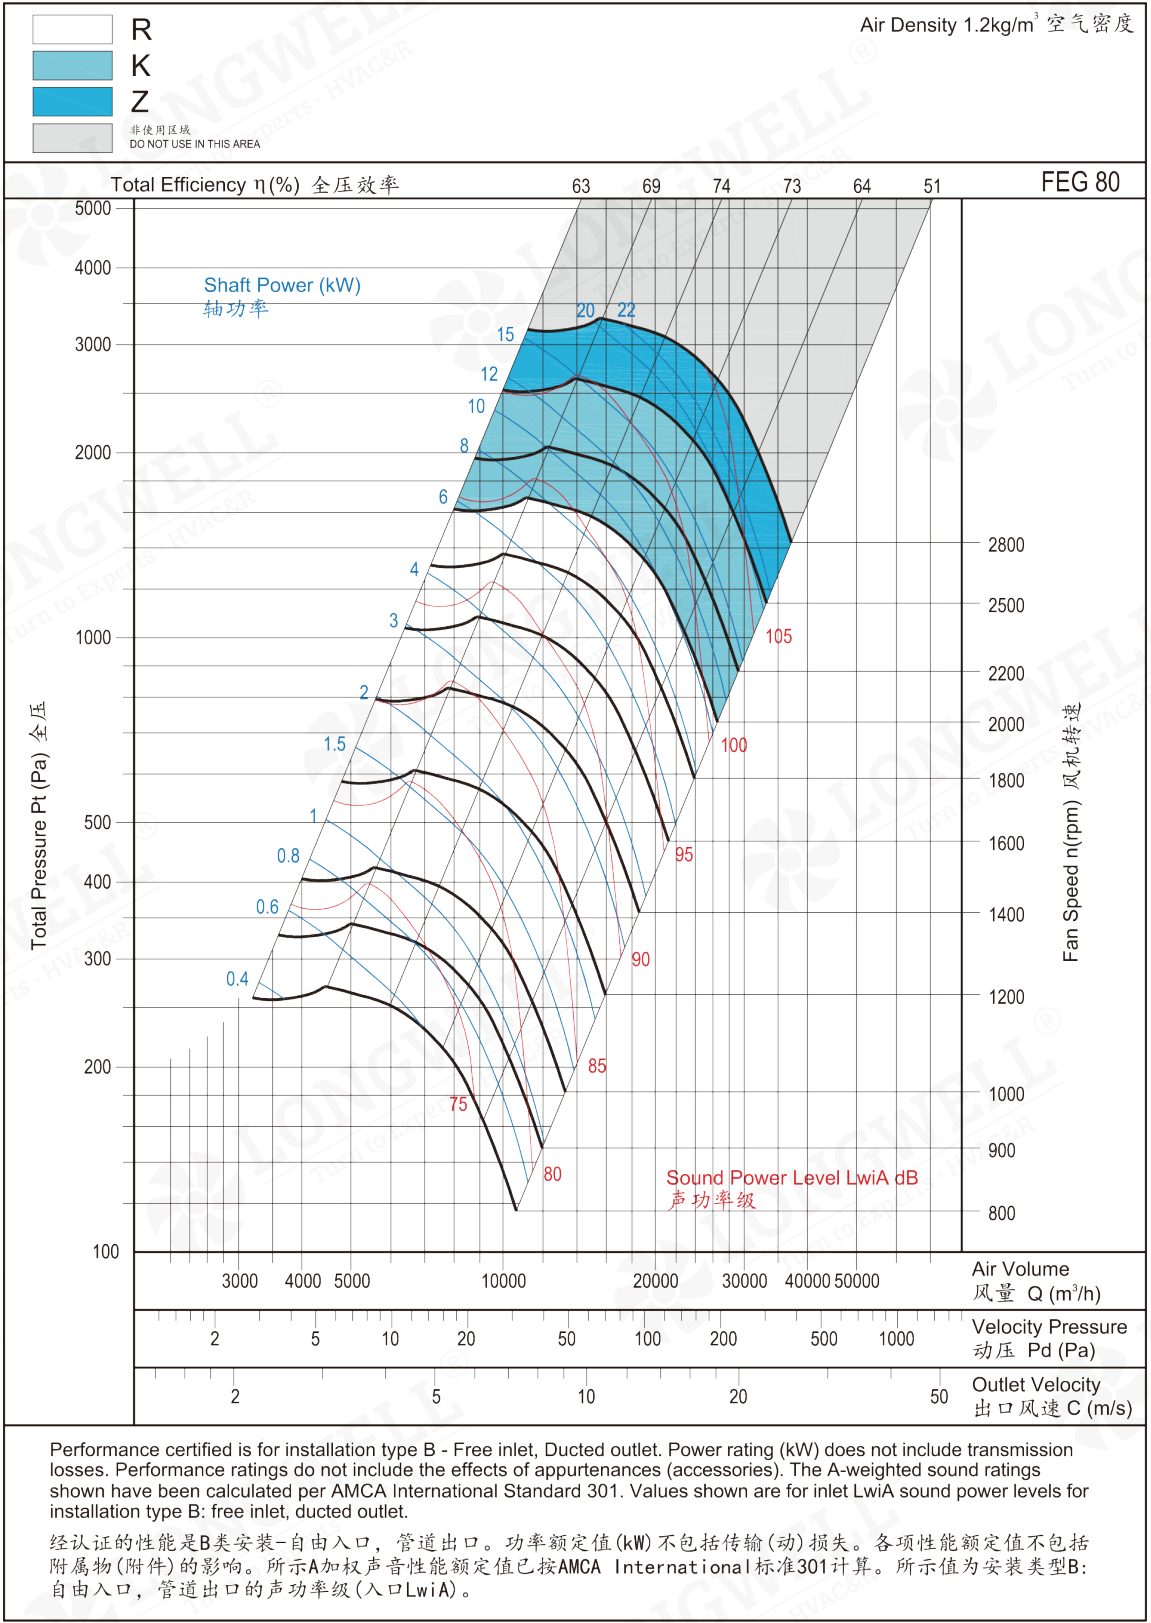


RDH-560

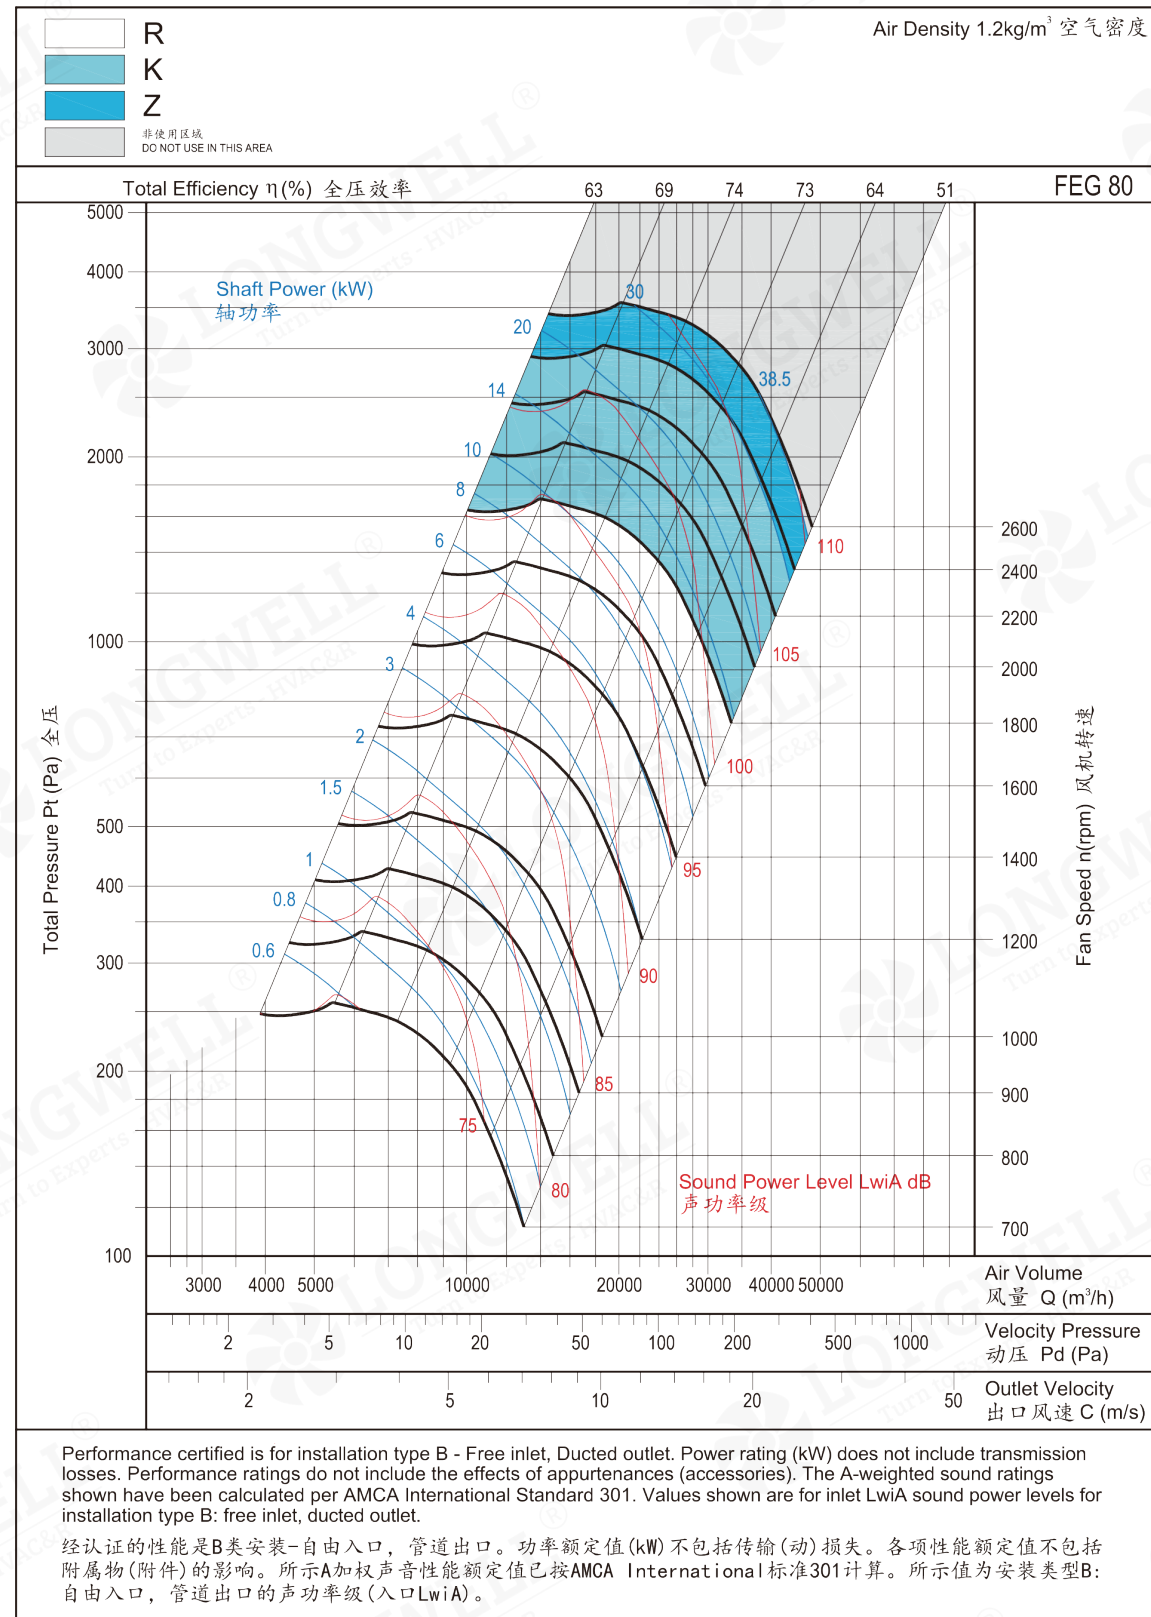


RDH-630

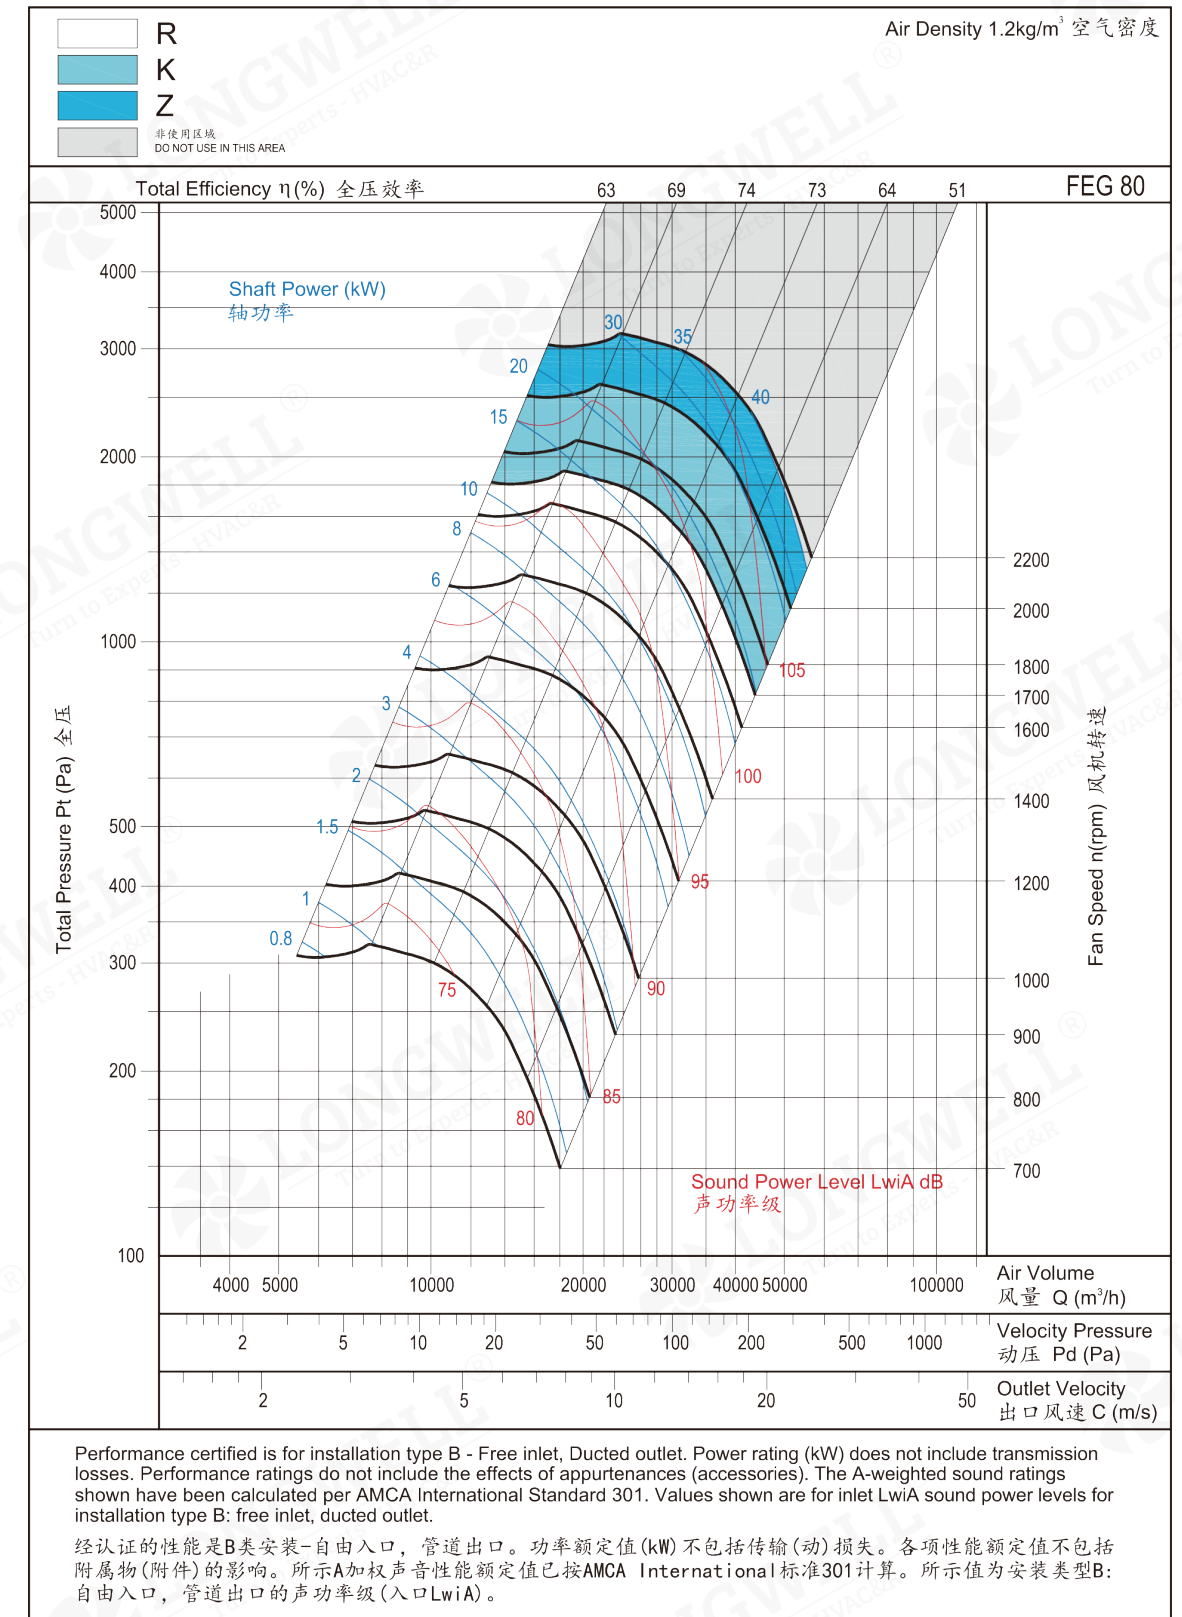


RDH-710

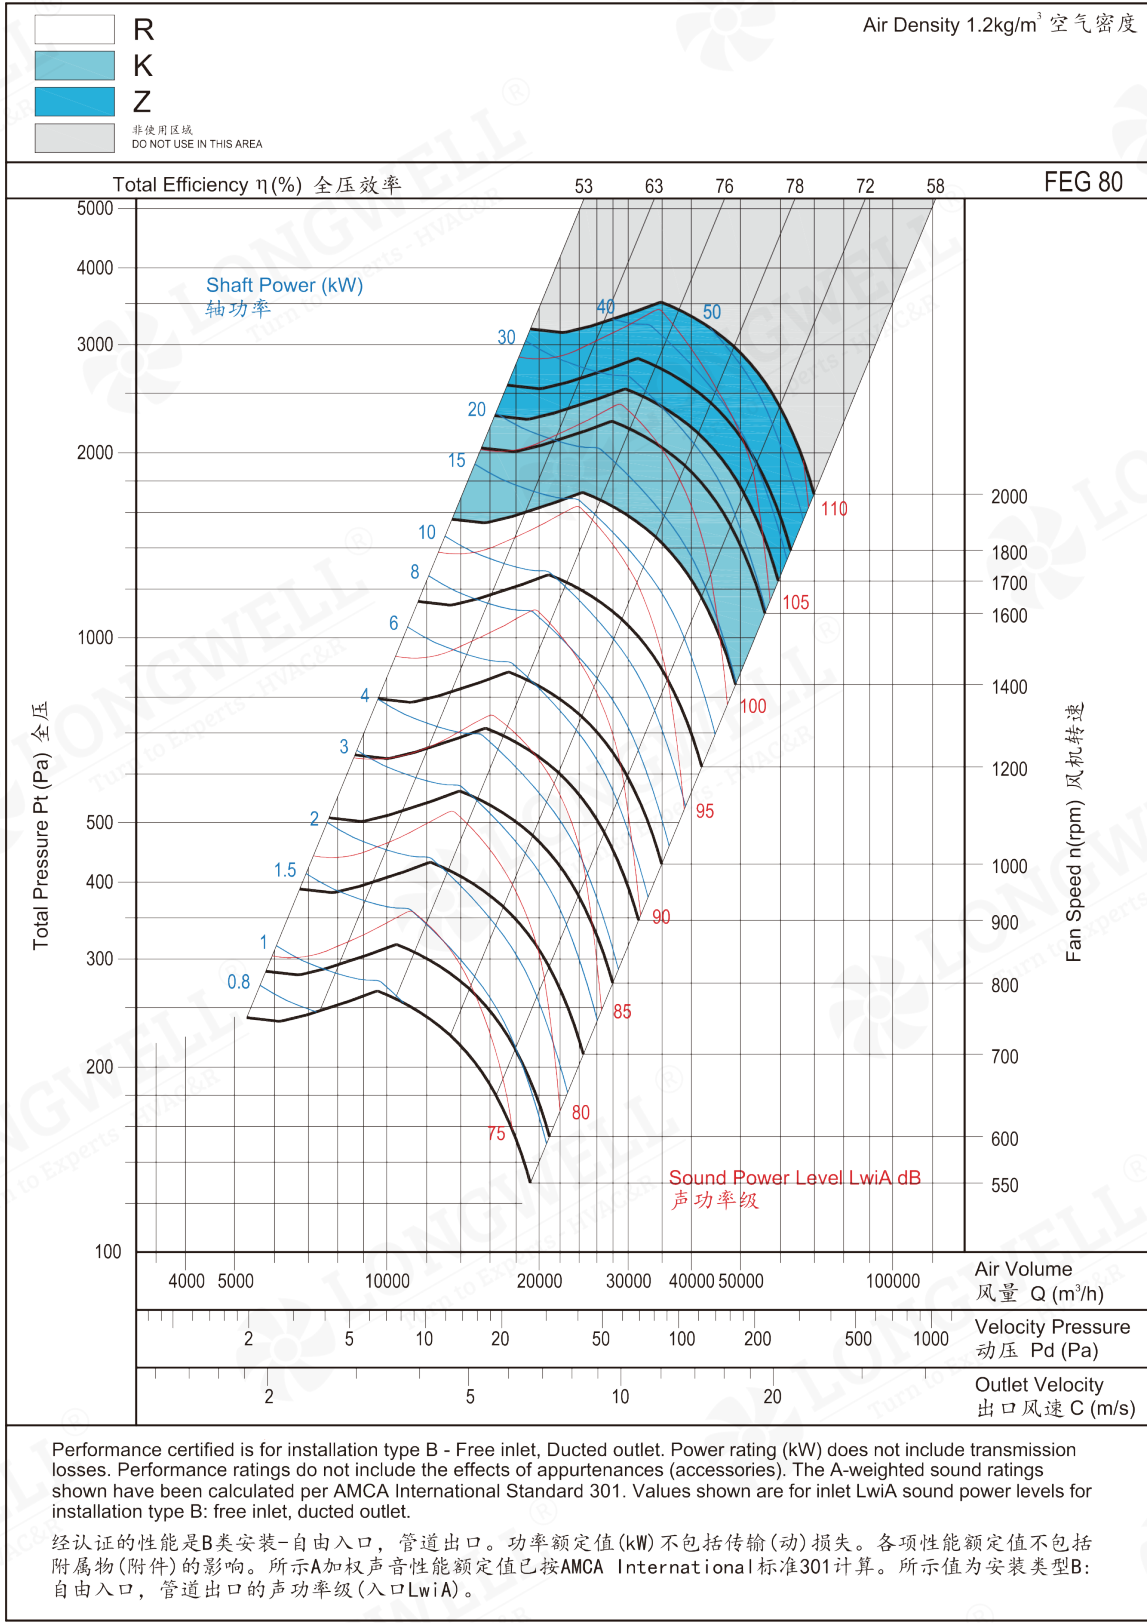


RDH-800

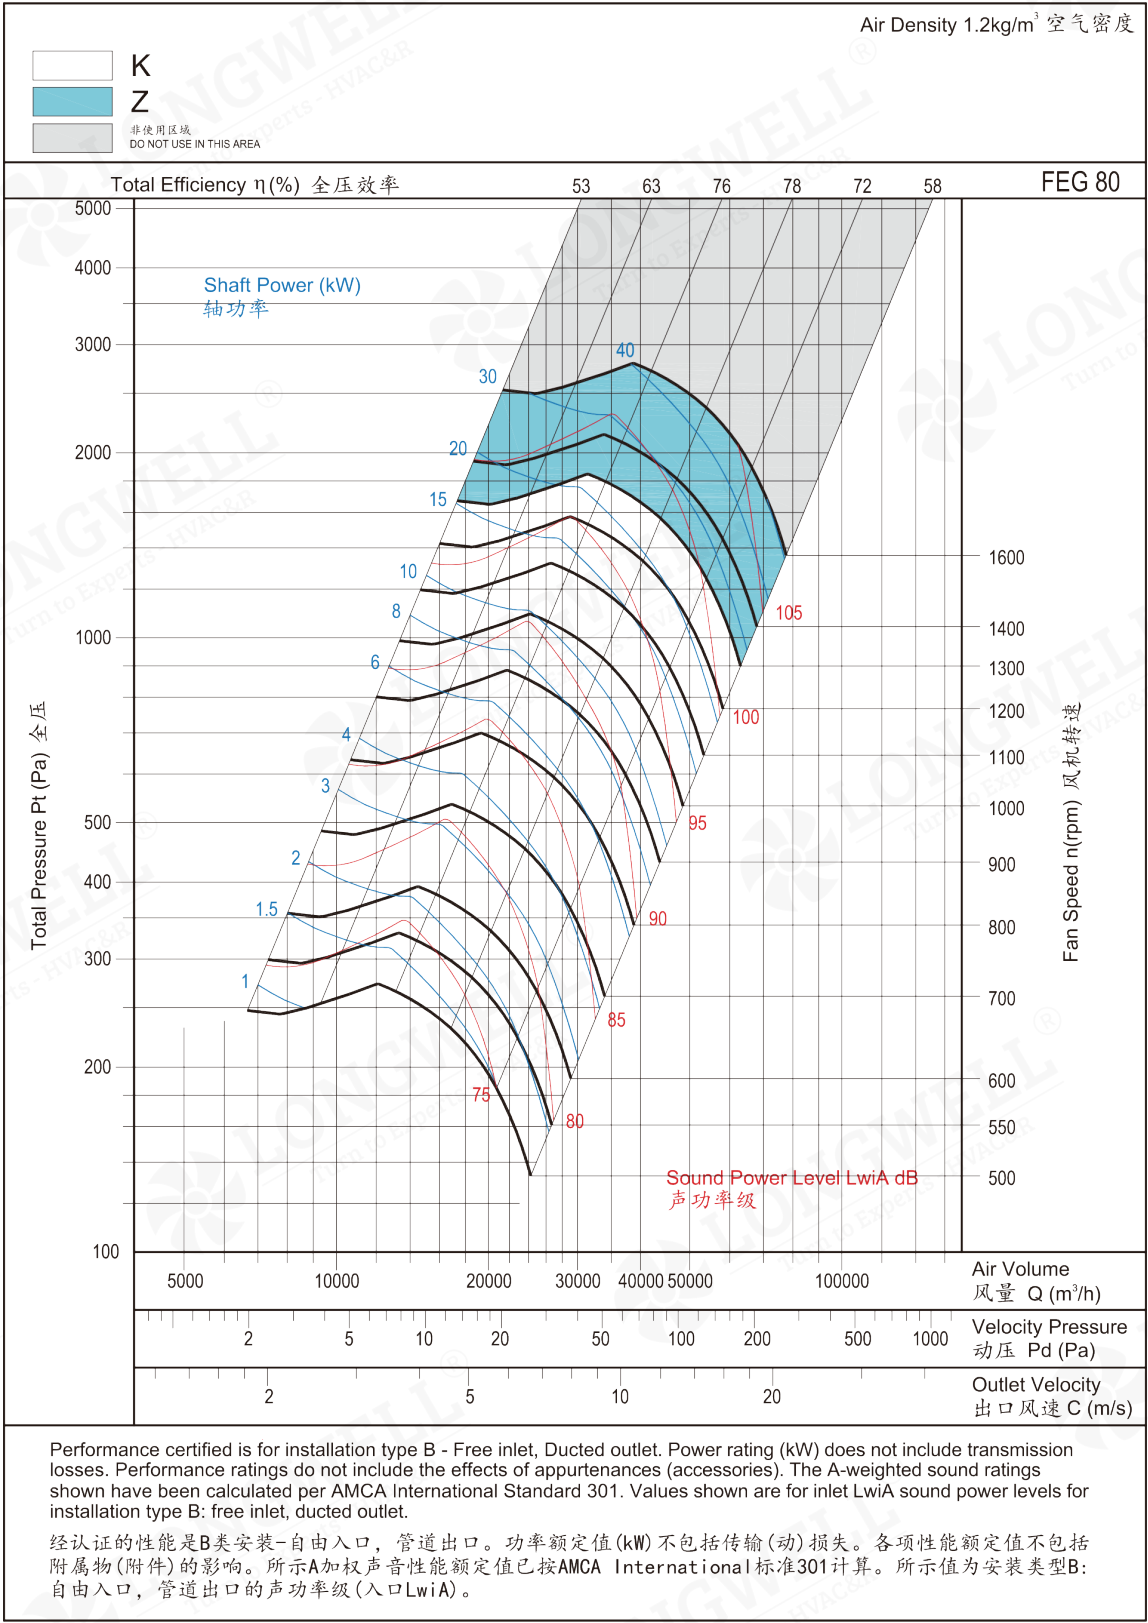

RDH-900

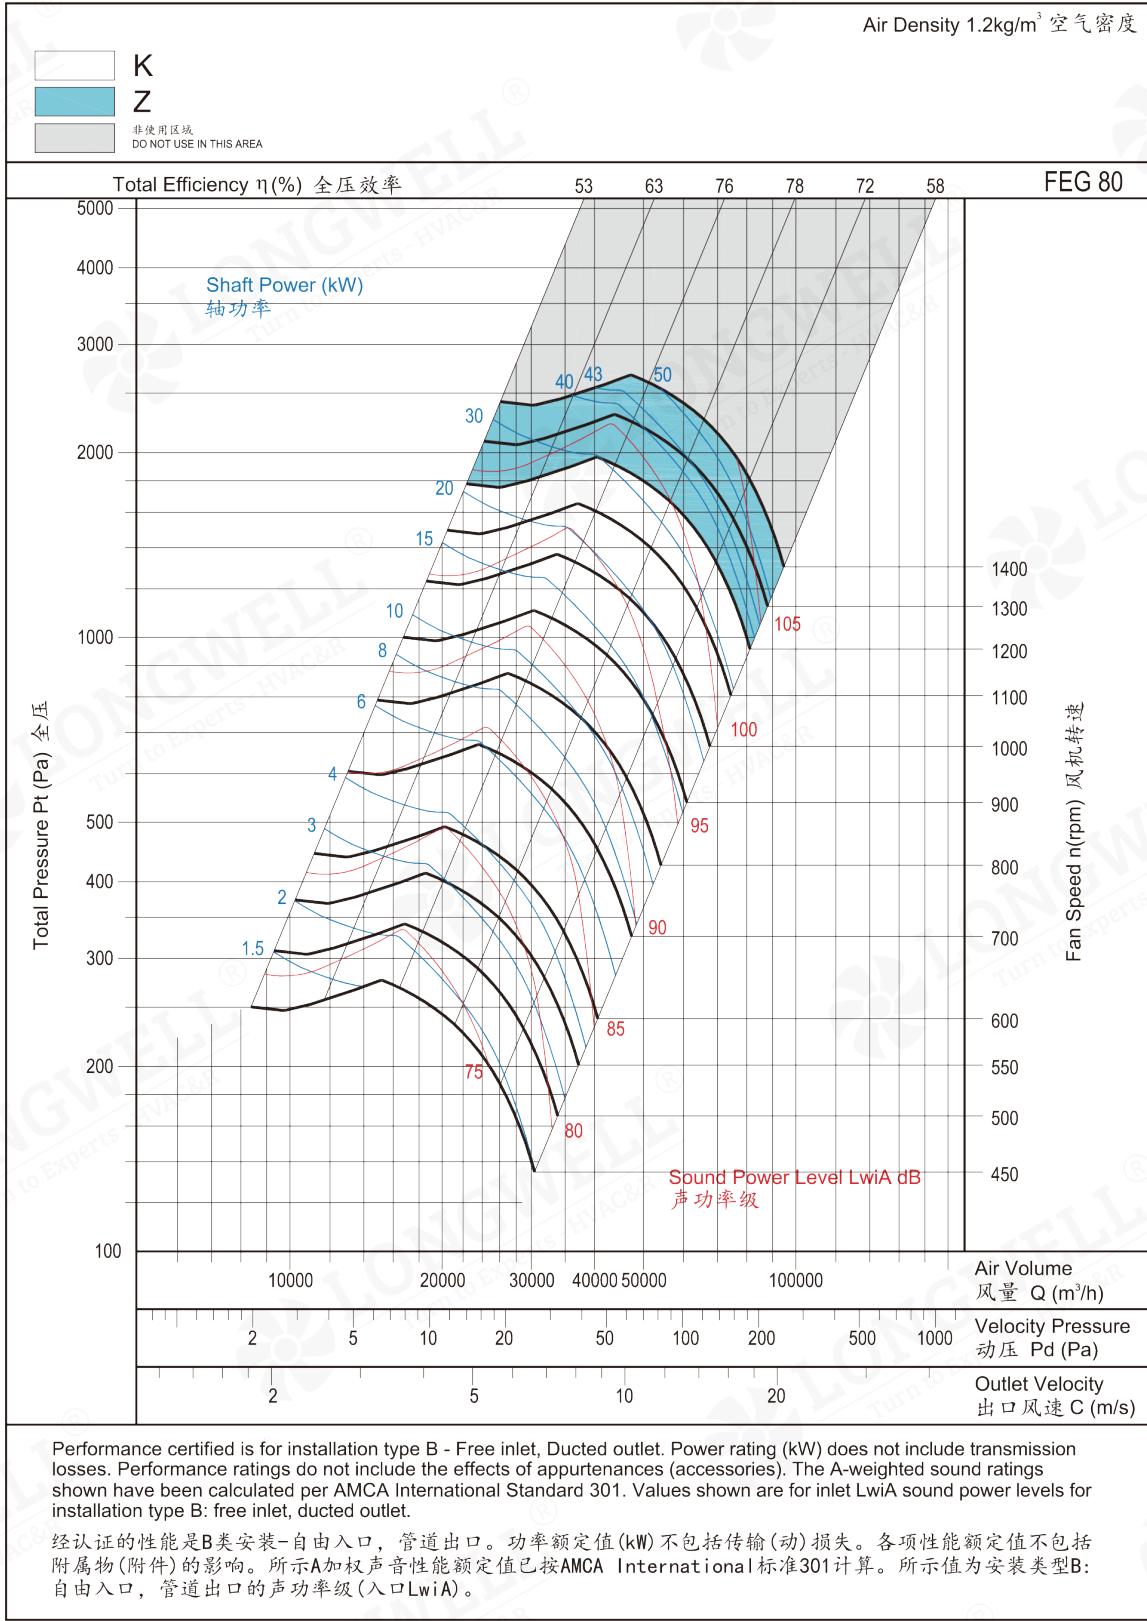

RDH-1000

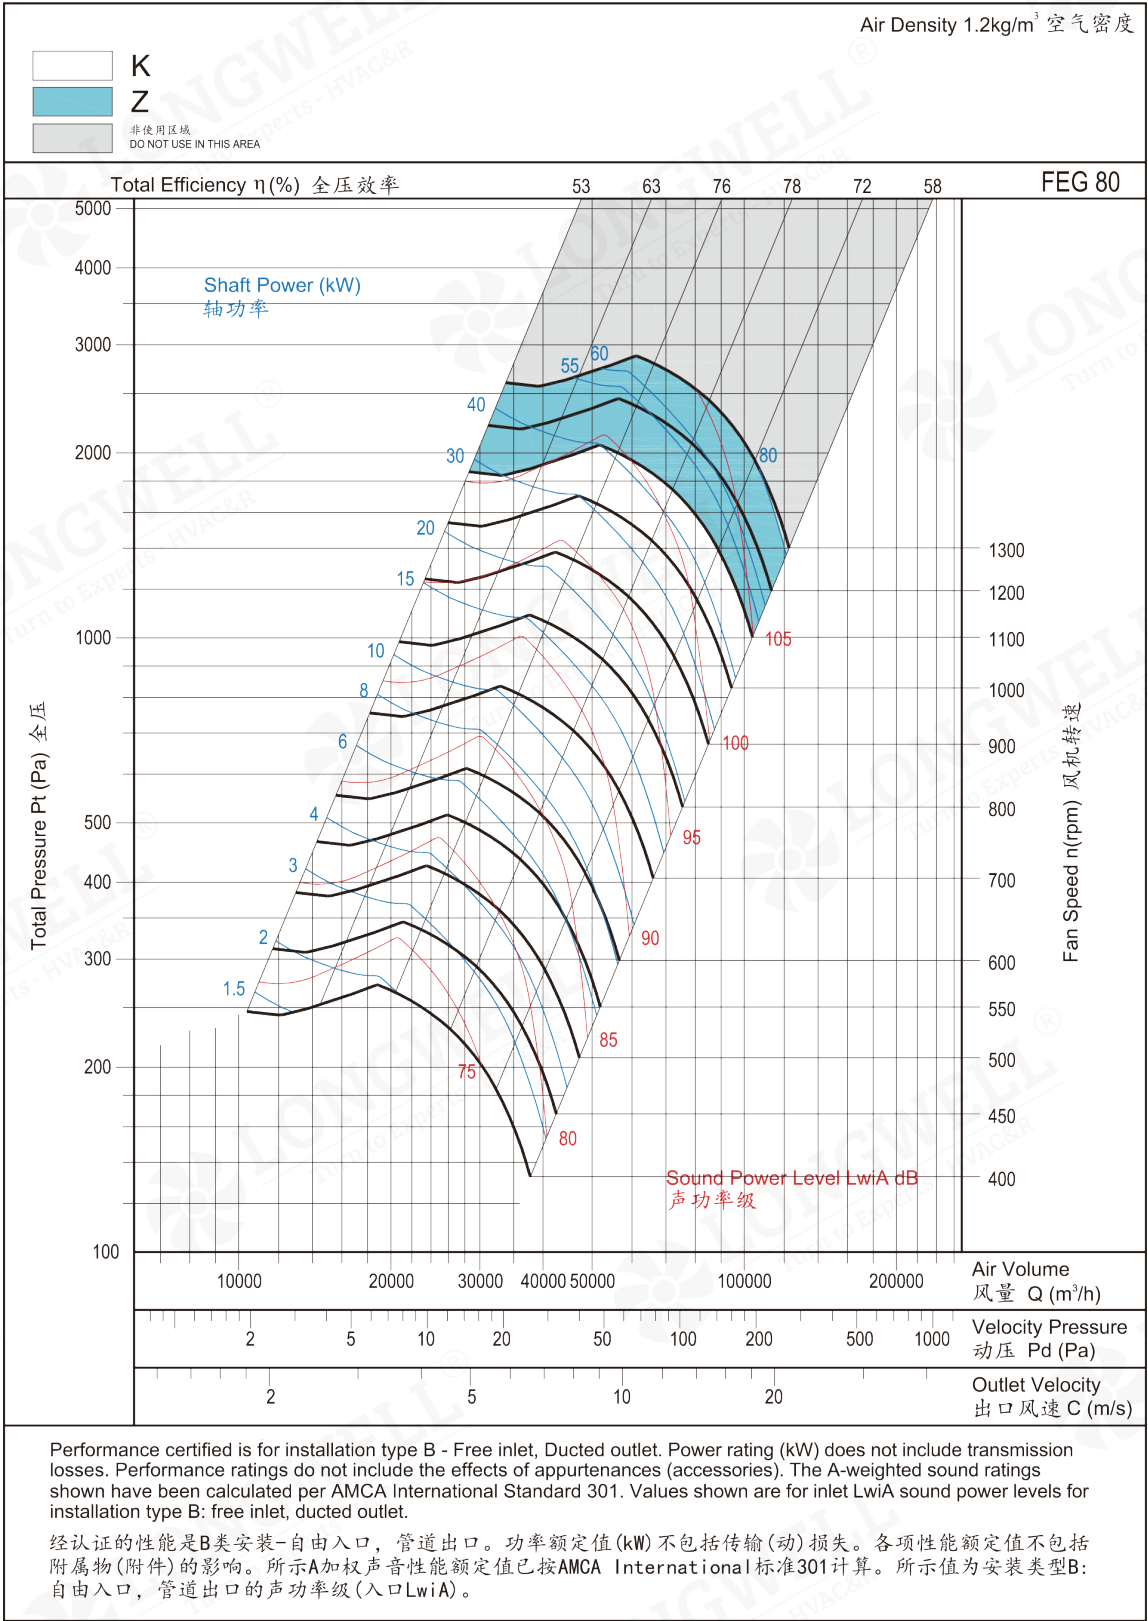

RDH - R(K)

0° 90° 180°													
LG													
RD													
Model	Motor Frame Size	A	Type R	Type K	C	A	Type R	Type K	C	A	Type R	Type K	C
280	71	730	575	600	568	820	575	600	516	730	575	600	568
	80	750	575	600	568	840	575	600	516	750	575	600	568
	90	760	575	600	568	850	575	600	516	760	575	600	568
	100	810	575	600	568	890	575	600	516	810	575	600	568
	112	850	575	600	568	930	575	600	516	850	575	600	568
	132	850	575	600	568	930	575	600	516	850	575	600	568
	160	900	575	600	568	980	575	600	516	900	575	600	568
315	71	790	640	665	628	900	640	665	568	790	640	665	628
	80	810	640	665	628	910	640	665	568	810	640	665	628
	90	830	640	665	628	930	640	665	568	830	640	665	628
	100	870	640	665	628	980	640	665	568	870	640	665	628
	112	925	640	665	628	1000	640	665	568	925	640	665	628
	132	930	640	665	628	1030	640	665	568	930	640	665	628
	160	980	640	665	628	1080	640	665	568	980	640	665	628
355	80	870	700	725	705	970	700	725	628	870	700	725	705
	90	890	700	725	705	990	700	725	628	890	700	725	705
	100	930	700	725	705	1030	700	725	628	930	700	725	705
	112	990	700	725	705	1090	700	725	628	990	700	725	705
	132	1020	700	725	705	1110	700	725	628	1020	700	725	705
	160	1070	700	725	705	1160	700	725	628	1070	700	725	705
	180	1120	700	725	705	1200	700	725	628	1120	700	725	705
400	90	980	760	790	786	1100	760	790	701	980	760	790	786
	100	1020	760	790	786	1140	760	790	701	1020	760	790	786
	112	1060	760	790	786	1190	760	790	701	1060	760	790	786
	132	1080	760	790	786	1210	760	790	701	1080	760	790	786
	160	1120	760	790	786	1240	760	790	701	1120	760	790	786
	180	1160	760	790	786	1300	760	790	701	1160	760	790	786
	90	1050	845	890	877	1200	845	890	776	1050	845	890	877
450	100	1100	845	890	877	1250	845	890	776	1100	845	890	877
	112	1150	845	890	877	1300	845	890	776	1150	845	890	877
	132	1220	845	890	877	1330	845	890	776	1220	845	890	877
	160	1270	845	890	877	1370	845	890	776	1270	845	890	877
	180	1310	845	890	877	1410	845	890	776	1310	845	890	877
	200	1350	845	890	877	1450	845	890	776	1350	845	890	877
	90	1100	915	960	981	1280	915	960	863	1100	915	960	981
500	100	1120	915	960	981	1120	915	960	863	1120	915	960	981
	112	1170	915	960	981	1340	915	960	863	1170	915	960	981
	132	1210	915	960	981	1385	915	960	863	1210	915	960	981
	160	1260	915	960	981	1430	915	960	863	1260	915	960	981
	180	1300	915	960	981	1470	915	960	863	1300	915	960	981
	200	1350	915	960	981	1520	915	960	863	1350	915	960	981

RDH - R(K)

0° 90° 180°													
LG													
RD													
Model	Motor Frame Size	A	Type R	Type K	C	A	Type R	Type K	C	A	Type R	Type K	C
560	90	1220	1000	1070	1093	1410	1000	1070	956	1220	1000	1070	1093
	100	1260	1000	1070	1093	1450	1000	1070	956	1260	1000	1070	1093
	112	1300	1000	1070	1093	1490	1000	1070	956	1300	1000	1070	1093
	132	1310	1000	1070	1093	1500	1000	1070	956	1310	1000	1070	1093
	160	1380	1000	1070	1093	1580	1000	1070	956	1380	1000	1070	1093
	180	1390	1000	1070	1093	1580	1000	1070	956	1390	1000	1070	1093
	200	1440	1000	1070	1093	1630	1000	1070	956	1440	1000	1070	1093
630	100	1400	1090	1155	1220	1610	1090	1155	1062	1400	1090	1155	1220
	112	1430	1090	1155	1220	1640	1090	1155	1062	1430	1090	1155	1220
	132	1450	1090	1155	1220	1660	1090	1155	1062	1450	1090	1155	1220
	160	1500	1090	1155	1220	1710	1090	1155	1062	1500	1090	1155	1220
	180	1520	1090	1155	1220	1730	1090	1155	1062	1520	1090	1155	1220
	200	1570	1090	1155	1220	1780	1090	1155	1062	1570	1090	1155	1220
	112	1600	1255	1290	1383	1850	1255	1290	1201	1600	1255	1290	1383
710	132	1650	1255	1290	1383	1900	1255	1290	1201	1650	1255	1290	1383
	160	1700	1255	1290	1383	1950	1255	1290	1201	1700	1255	1290	1383
	180	1750	1255	1290	1383	2000	1255	1290	1201	1750	1255	1290	1383
	200	1770	1255	1290	1383	2020	1255	1290	1201	1770	1255	1290	1383
	225	1800	1255	1290	1383	2050	1255	1290	1201	1800	1255	1290	1383
	132	1710	/	1450	1548	1950	/	1450	1330	1710	/	1450	1548
	160	1750	/	1450	1548	2040	/	1450	1330	1750	/	1450	1548
800	180	1770	/	1450	1548	2060	/	1450	1330	1770	/	1450	1548
	200	1820	/	1450	1548	2110	/	1450	1330	1820	/	1450	1548
	225	1850	/	1450	1548	2140	/	1450	1330	1850	/	1450	1548
	250	1900	/	1450	1548	2190	/	1450	1330	1900	/	1450	1548
	132	1860	/	1570	1748	2210	/	1570	1508	1860	/	1570	1748
	160	1900	/	1570	1748	2250	/	1570	1508	1900	/	1570	1748
	180	1950	/	1570	1748	2300	/	1570	1508	1950	/	1570	1748
900	200	2000	/	1570	1748	2350	/	1570	1508	2000	/	1570	1748
	225	2030	/	1570	1748	2380	/	1570	1508	2030	/	1570	1748
	250	2080	/	1570	1748	2430	/	1570	1508	2080	/	1570	1748
	280	2150	/	1570	1748	2500	/	1570	1508	2150	/	1570	1748
	132	2110	/	1700	1910	2410	/	1700	1641	2110	/	1700	1910
	160	2150	/	1700	1910	2450	/	1700	1641	2150	/	1700	1910
	180	2200	/	1700	1910	2500	/	1700	1641	2200	/	1700	1910
1000	200	2200	/	1700	1910	2500	/	1700	1641	2200	/	1700	1910
	225	2250	/	1700	1910	2650	/	1700	1641	2250	/	1700	1910
	250	2330	/	1700	1910	2630	/	1700	1641	2330	/	1700	1910
	280	2400	/	1700	1910	2700	/	1700	1641	2400	/	1700	1910

RDH - R(K)

0°																90°					180°				
LG																									
RD																									
Model	Motor Frame Size	A	Type B	Type K	C	D	A	Type B	Type K	C	D	A	Type B	Type K	C	D									
280	71	750	575	600	568	612	750	575	600	516	612	750	575	600	568	612									
	80	770	575	600	568	612	770	575	600	516	612	770	575	600	568	612									
	90	810	575	600	568	612	810	575	600	516	612	810	575	600	568	612									
	100	870	575	600	568	612	870	575	600	516	612	870	575	600	568	612									
	112	890	575	600	568	612	890	575	600	516	612	890	575	600	568	612									
	132	990	575	600	568	612	990	575	600	516	612	990	575	600	568	612									
	160	1150	575	600	568	612	1030	575	600	516	612	1030	575	600	568	612									
315	71	790	640	665	628	617	790	640	665	568	617	790	640	665	628	617									
	80	810	640	665	628	617	810	640	665	568	617	810	640	665	628	617									
	90	860	640	665	628	617	860	640	665	568	617	860	640	665	628	617									
	100	910	640	665	628	617	910	640	665	568	617	910	640	665	628	617									
	112	930	640	665	628	617	930	640	665	568	617	930	640	665	628	617									
	132	1030	640	665	628	617	1030	640	665	568	617	1030	640	665	628	617									
	160	1190	640	665	628	617	1070	640	665	568	617	1070	640	665	628	617									
355	71	850	700	725	705	655	850	700	725	628	655	850	700	725	705	655									
	80	870	700	725	705	655	870	700	725	628	655	870	700	725	705	655									
	90	920	700	725	705	655	920	700	725	628	655	920	700	725	705	655									
	100	970	700	725	705	655	970	700	725	628	655	970	700	725	705	655									
	112	990	700	725	705	655	990	700	725	628	655	990	700	725	705	655									
	132	1090	700	725	705	655	1090	700	725	628	655	1090	700	725	705	655									
	160	1250	700	725	705	655	1130	700	725	628	655	1130	700	725	705	655									
400	80	960	760	790	786	736	960	760	790	613	736	960	760	790	786	736									
	90	1000	760	790	786	736	1000	760	790	613	736	1000	760	790	786	736									
	100	1050	760	790	786	736	1050	760	790	613	736	1050	760	790	786	736									
	112	1070	760	790	786	736	1070	760	790	613	736	1070	760	790	786	736									
	132	1170	760	790	786	736	1170	760	790	613	736	1170	760	790	786	736									
	160	1300	760	790	786	736	1300	760	790	613	736	1300	760	790	786	736									
	180	1380	760	790	786	736	1380	760	790	613	736	1380	760	790	786	736									
450	90	1050	845	890	877	827	1050	845	890	776	827	1050	845	890	877	827									
	100	1100	845	890	877	827	1100	845	890	776	827	1100	845	890	877	827									
	112	1120	845	890	877	827	1120	845	890	776	827	1120	845	890	877	827									
	132	1220	845	890	877	827	1220	845	890	776	827	1220	845	890	877	827									
	160	1300	845	890	877	827	1300	845	890	776	827	1300	845	890	877	827									
	180	1380	845	890	877	827	1380	845	890	776	827	1380	845	890	877	827									
	200	1440	845	890	877	827	1440	845	890	776	827	1440	845	890	877	827									
500	90	1130	915	960	981	918	1130	915	960	863	918	1130	915	960	981	918									
	100	1150	915	960	981	918	1150	915	960	863	918	1150	915	960	981	918									
	112	1190	915	960	981	918	1190	915	960	863	918	1190	915	960	981	918									
	132	1290	915	960	981	918	1290	915	960	863	918	1290	915	960	981	918									
	160	1430	915	960	981	918	1430	915	960	863	918	1430	915	960	981	918									
	180	1500	915	960	981	918	1500	915	960	863	918	1500	915	960	981	918									
	200	1560	915	960	981	918	1560	915	960	863	918	1560	915	960	981	918									

RDH - R(K)

0°																90°						180°					
LG																											
Model	Motor Frame Size	A	Type R	B Type K	C	D	A	Type R	B Type K	C	D	A	Type R	B Type K	C	D											
560	90	1250	1000	1070	1093	1030	1250	1000	1070	956	1030	1250	1000	1070	1093	1030											
	100	1290	1000	1070	1093	1030	1290	1000	1070	956	1030	1290	1000	1070	1093	1030											
	112	1300	1000	1070	1093	1030	1300	1000	1070	956	1030	1300	1000	1070	1093	1030											
	132	1400	1000	1070	1093	1030	1400	1000	1070	956	1030	1400	1000	1070	1093	1030											
	160	1550	1000	1070	1093	1030	1550	1000	1070	956	1030	1550	1000	1070	1093	1030											
	180	1600	1000	1070	1093	1030	1600	1000	1070	956	1030	1600	1000	1070	1093	1030											
	200	1660	1000	1070	1093	1030	1660	1000	1070	956	1030	1660	1000	1070	1093	1030											
630	90	1340	1090	1155	1220	1157	1340	1090	1155	1062	1157	1340	1090	1155	1220	1157											
	100	1380	1090	1155	1220	1157	1380	1090	1155	1062	1157	1380	1090	1155	1220	1157											
	112	1400	1090	1155	1220	1157	1400	1090	1155	1062	1157	1400	1090	1155	1220	1157											
	132	1480	1090	1155	1220	1157	1480	1090	1155	1062	1157	1480	1090	1155	1220	1157											
	160	1620	1090	1155	1220	1157	1620	1090	1155	1062	1157	1620	1090	1155	1220	1157											
	180	1680	1090	1155	1220	1157	1680	1090	1155	1062	1157	1680	1090	1155	1220	1157											
	200	1740	1090	1155	1220	1157	1740	1090	1155	1062	1157	1740	1090	1155	1220	1157											
710	100	1480	1255	1290	1383	1303	1480	1255	1290	1508	1303	1480	1255	1290	1383	1303											
	112	1500	1255	1290	1383	1303	1500	1255	1290	1508	1303	1500	1255	1290	1383	1303											
	132	1600	1255	1290	1383	1303	1600	1255	1290	1508	1303	1600	1255	1290	1383	1303											
	160	1730	1255	1290	1383	1303	1730	1255	1290	1508	1303	1730	1255	1290	1383	1303											
	180	1800	1255	1290	1383	1303	1800	1255	1290	1508	1303	1800	1255	1290	1383	1303											
	200	1850	1255	1290	1383	1303	1850	1255	1290	1508	1303	1850	1255	1290	1383	1303											
	225	1920	1255	1290	1383	1303	1920	1255	1290	1508	1303	1920	1255	1290	1383	1303											
800	100	1650	/	1450	1548	1468	1650	/	1450	1330	1468	1650	/	1450	1548	1468											
	112	1650	/	1450	1548	1468	1650	/	1450	1330	1468	1650	/	1450	1548	1468											
	132	1720	/	1450	1548	1468	1720	/	1450	1330	1468	1720	/	1450	1548	1468											
	160	1800	/	1450	1548	1468	1880	/	1450	1330	1468	1880	/	1450	1548	1468											
	180	1950	/	1450	1548	1468	1950	/	1450	1330	1468	1950	/	1450	1548	1468											
	200	2000	/	1450	1548	1468	2000	/	1450	1330	1468	2000	/	1450	1548	1468											
	225	2050	/	1450	1548	1468	2050	/	1450	1330	1468	2050	/	1450	1548	1468											
900	132	1860	/	1570	1748	1648	1860	/	1570	1748	1648	1860	/	1570	1748	1648											
	160	1980	/	1570	1748	1648	1980	/	1570	1748	1648	1980	/	1570	1748	1648											
	180	2030	/	1570	1748	1648	2030	/	1570	1748	1648	2030	/	1570	1748	1648											
	200	2100	/	1570	1748	1648	2100	/	1570	1748	1648	2100	/	1570	1748	1648											
	225	2170	/	1570	1748	1648	2170	/	1570	1748	1648	2170	/	1570	1748	1648											
	250	2270	/	1570	1748	1648	2270	/	1570	1748	1648	2270	/	1570	1748	1648											
	280	2370	/	1570	1748	1648	2370	/	1570	1748	1648	2370	/	1570	1748	1648											
1000	132	1990	/	1700	1910	1810	1990	/	1700	1641	1810	1990	/	1700	1910	1810											
	160	2110	/	1700	1910	1810	2110	/	1700	1641	1810	2110	/	1700	1910	1810											
	180	2160	/	1700	1910	1810	2160	/	1700	1641	1810	2160	/	1700	1910	1810											
	200	2230	/	1700	1910	1810	2230	/	1700	1641	1810	2230	/	1700	1910	1810											
	225	2300	/	1700	1910	1810	2300	/	1700	1641	1810	2300	/	1700	1910	1810											
	250	2390	/	1700	1910	1810	2390	/	1700	1641	1810	2390	/	1700	1910	1810											
	280	2500	/	1700	1910	1810	2500	/	1700	1641	1810	2500	/	1700	1910	1810											

RDH Series Ventilator Operational Limits

			280	315	355	400	450	500	560	630	710	800	900	1000
Max.absorbed Power	L	KW	/	/	/	/	/	/	/	/	/	/	/	/
	R	KW	5.5	4.8	5.5	6	8	12	14	20	20	/	/	/
	K	KW	8	8	15	15	15	22	30	35	40	30	43	55
	Z	KW	/	/	/	/	/	30	38.5	40	60	65	65	80
	R2	KW	5.5	6.5	8.5	8.5	12	13	14	18	18	/	/	/
	K2	KW	/	/	13	13	18.5	22	32	34	45	45	45	65
Max.R.P.M	L	rpm	/	/	/	/	/	/	/	/	/	/	/	/
	R	rpm	4000	3200	2800	2400	2200	2000	1800	1700	1400	/	/	/
	K	rpm	4500	4000	3800	3200	2800	2500	2400	2000	1700	1300	1200	1100
	Z	rpm	/	/	/	/	/	2800	2600	2200	2000	1600	1400	1300
	R2	rpm	3200	2800	2600	2100	1800	1600	1400	1200	1000	/	/	/
	K2	rpm	/	/	3000	2400	2200	2000	1800	1600	1400	1200	1000	900
Air Temperature Limits (Min-20°C)	L	Max.°C	/	/	/	/	/	/	/	/	/	/	/	/
	R/R2	Max.°C	85	85	85	85	85	85	85	85	85	/	/	/
	K/K2	Max.°C	85	85	85	85	85	85	85	85	85	85	85	85
	Z	Max.°C	/	/	/	/	/	85	85	85	85	85	85	85
Fan Weight	L	Kg	/	/	/	/	/	/	/	/	/	/	/	/
	R	Kg	22	32.6	42.7	50.6	67.5	84.2	142	168	223	/	/	/
	K	Kg	32	42.6	54.7	63.6	82.5	104.2	171	197	271	300	481.5	530
	Z	Kg	/	/	/	/	/	107	174	200	274	304	485	535
	R2	Kg	46	67	91	107	143	176	300	352	462	/	/	/
	K2	Kg	/	/	111	127	173	217	358	410	558	616	989	1086

Fan Selection Criteria

- 1.the selection of high efficiency,the smaller the smaller,the larger the scope of the wind turbine,to meet the system can accept the performance,efficiency and quality requirements.The fan operating point,should be selected in the vicinity of high efficiency fan,to ensure stable operation,avoid the work of the fan in the surge zone.To reduce the noise,we must reduce the speed of the wind turbine, the choice of a large fan.AV system fan,air pressure should be selected according to the operating time of a longer part of the load conditions.
- 2.the choice of a strong wind turbine,often make the wind turbine running in the small wind area. the pressure difference between the inlet and outlet of the wind turbine,will cause the operation of instability and noise pulse.higher noise.After selection of wind machine,will raise the rotation speed of the fan,air leaving the blades have higher speed,also can produce high noise.The average speed of the air blower is M/S 10-15.
- 3.before to the multi blade fan:has the advantages of low speed,light structure,low noise,good speed regulation performance and cheap price,when the design flow and the pressure of small or large volume low pressure should give high priority to the use of wind turbine.After the wind machine, which has the advantages of high efficiency,low noise,high pressure and structure characteristics of strong,when the design pressure of fan is large should givel high priority to the use of wind turbine. No shell fan: when the pipe network needs a flexible export position,need to reduce the pipeline outlet noise,or pipe network in the future may change the occasion should be preferred.
- 4.total pressure curve is flat,small steepness,static pressure has a great influence on the wind power,performance and wider range of fan for air volume system,the static pressure sensitive,need air conditioning VAV air conditioning units.Full pressure curve is steep,steep,static pressure of air power influence small windl machine,suitable for fixed volume of air conditioner,before the wind turbine motor is not overloaded.The belt drive fan to pole motor with 4/6.